


ENERGY RECOVERY VENTILATORS


ERV3500-ECP

Technical Data



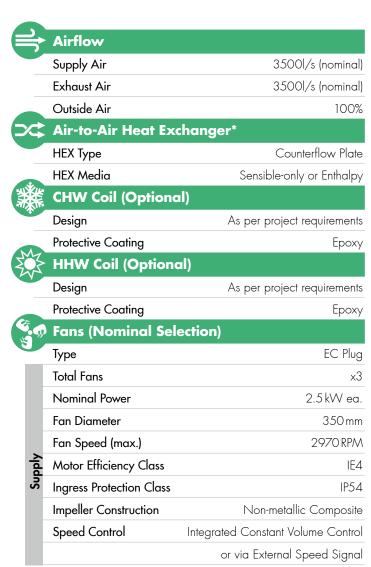

^{*} The plate heat exchangers are designed to operate to a maximum 300Pa pressure differential (inlet condition) between primary and secondary air streams.

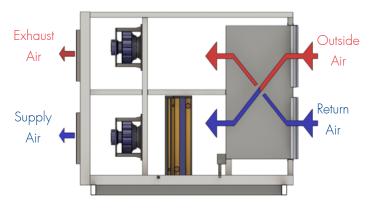

Contact your Air Change representative for a psychrometric unit selection

15	🕏 Fans (Nominal Sel	ection)
	Туре	EC Plug
	Total Fans	x3
	Nominal Power	2.5 kW ea.
	Fan Diameter	350 mm
	Fan Speed (max.)	2970 RPM
	Fan Speed (max.) Motor Efficiency Class Ingress Protection Class	IE4
-	Ingress Protection Class	IP54
	Impeller Construction	Non-metallic Composite
	Speed Control	Integrated Constant Volume Control
		or via External Speed Signal
	Cabinet	
	Weatherproof	Yes
	Panel Construction	50 mm PIR Sandwich Panel

Cabinet	
Weatherproof	Yes
Panel Construction	50 mm PIR Sandwich Panel
	(FM Approved 4880/4881 - Class 1)
Panel Finish	Colorbond "Surfmist"
Panel R-Value	$2.63\mathrm{K.m^2/W}$
Panel Joiner Material	UV Resistant Polymer
Base Frame	Galvanised Steel with Lifting Lugs
Anti-corrosion Treatme	nt Optional
Filter Section	Not included

(filters to be mounted in RA & OA ductwork)

		Illiela la pa ll'adillea ili ili la ca an l'adelwork
P	Operating Mo	odes
	Energy Recovery	Default
	Economy Cycle	HEX Bypass for Free Cooling (optional)
	Return Air Bypass	HEX Bypass for Recirculation (optional)




ERV3500-FCP


Dimensions

0

Dimensions (without Economy Cycle Option)*

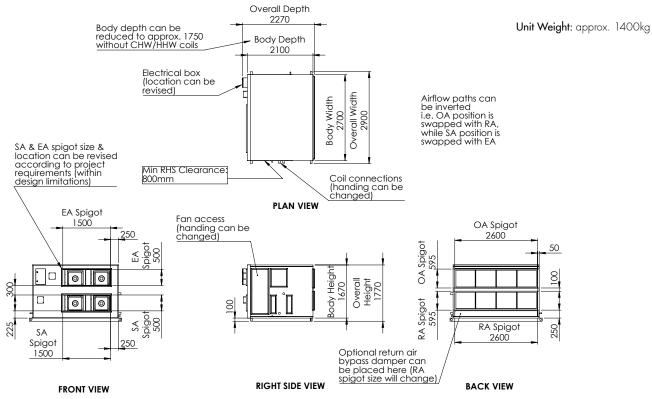

Dimensions (with Economy Cycle Option)*

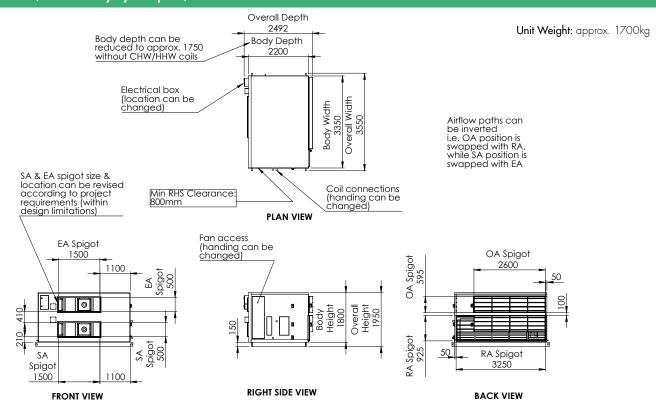

^{*} Dimensions and weight are subject to change, depending on project requirements. Refer to project certified drawings for finalised details.




ERV3500-ECP

Electrical




Wiring Diagram (without Economy Cycle and Return Air Bypass Modes)*

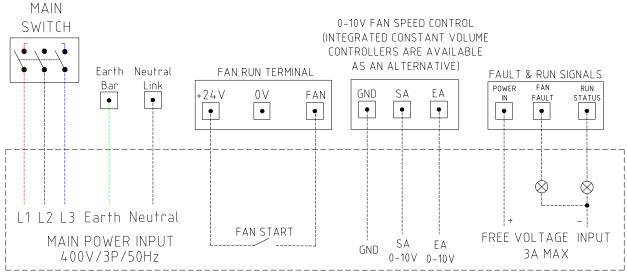

CLIENT CONTROL CONNECTION



Wiring Diagram (with Economy Cycle and Return Air Bypass Modes)*

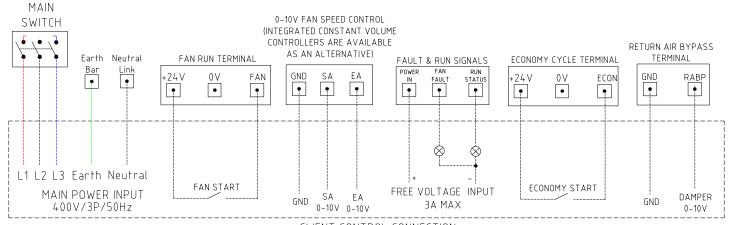

CLIENT CONTROL CONNECTION



Electrical Input †

Voltage / Phases / Frequency	415V / 3ph / 50Hz				
Full Load Amps	24A				

^{*} Connection details are subject to change, depending on project requirements. Refer to project certified electrical diagrams for finalised details.


[†] Unit electrical input is subject to change, depending on project requirements. Refer to project certified electrical diagrams for finalised details.



ERV3500-ECP

Airflow & Noise



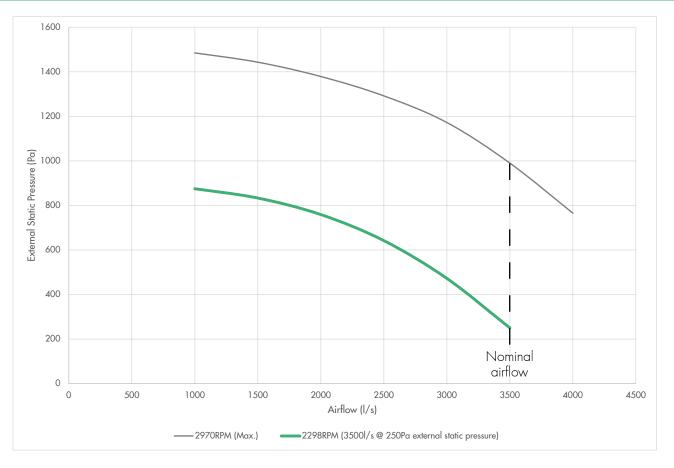

Supply Air Fan Power (35001/s @ 250Pa External Static Pressure)*

Absorbed Power (all fans combined) 3.31kW

(Sound Power)†

3500l/s @ 250Pa External Static Pressure									
Inlet									
Frequency (Hz)	sum	63	125	250	500	1000	2000	4000	8000
A-weighted (dB)	81	46	54	76	<i>7</i> 5	72	74	70	70
Non A-weighted (dB)	86	72	70	85	79	<i>7</i> 3	72	69	72
Outlet									
Frequency (Hz)	sum	63	125	250	500	1000	2000	4000	8000
A-weighted (dB)	86	47	56	<i>7</i> 5	<i>7</i> 6	82	80	<i>7</i> 6	73
Non A-weighted (dB)	88	72	72	83	<i>7</i> 9	82	<i>7</i> 9	<i>7</i> 5	<i>7</i> 4
± N.1	1 · f		e I d	1					

[†] Noise data considers supply air fans only, without attenuation by the cabinet.

^{*} Fan curve makes allowance for internal pressure drop of unit (incl. CHW & HHW coils). This pressure drop is subject to change, depending on project requirements. Supply air fan selection options are available.




ERV3500-ECP

Airflow & Noise



Exhaust Air Fan Curve*

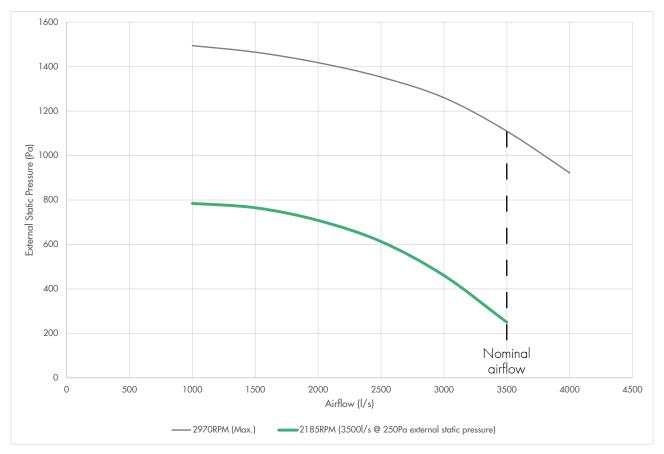

Exhaust Air Fan Power (3500l/s @ 250Pa External Static Pressure)*

Absorbed Power (all fans combined) 2.77kW

)@

Exhaust Air Fan Acoustics (Sound Power)†

3500l/s @ 250Pa External Static Pressure										
Inlet										
Frequency (Hz)	sum	63	125	250	500	1000	2000	4000	8000	
A-weighted (dB)	81	46	57	74	<i>7</i> 5	72	73	70	70	
Non A-weighted (dB)	85	72	72	82	79	72	72	69	72	
Outlet										
Frequency (Hz)	sum	63	125	250	500	1000	2000	4000	8000	
A-weighted (dB)	86	47	58	74	77	82	79	75	73	
Non A-weighted (dB)	88	72	73	83	80	82	78	74	<i>7</i> 4	

[†] Noise data considers exhaust air fans only, without attenuation by the cabinet.

^{*} Fan curve makes allowance for internal pressure drop of unit. This pressure drop is subject to change, depending on project requirements. Exhaust air fan selection options are available.