
INSTALLATION, OPERATION & SERVICE MANUAL

HIGHWALL SWC-EC



INVESTING IN QUALITY, RELIABILITY & PERFORMANCE

ISO 9001 QUALITY



Management Service

Every product is manufactured to meet the stringent requirements of the internationally recognized ISO 9001 standard for quality assurance in design, development and production.

World Leading Design and Technology

Equipped with the latest air-conditioning test rooms and manufacturing technology, we produce over 50,000 fan coil units each year, all conforming to the highest international standards of quality and safety.

CE SAFETY STANDARDS



Product Service

All products conform to the Certificate Europe directives (Machinery Safety, Electromagnetic Compatibility and Low Voltage), as required throughout the European Community, to guarantee correct standards of safety.

The Highest Standards of Manufacturing

In order to guarantee the very highest standards and performance, we manage every stage in the manufacturing of our products. Throughout the production process we maintain strict control, starting with our extensive resources in research and development through to the design and manufacture of almost every individual component, from molded plastics to the assembly of units and controllers.

EUROVENT CERTIFICATION



WEEE MARK



All products conform to the "WEEE" directive to guarantee correct standards of environmental solutions.

Quality Controlled from Start to Finish

Our highly trained staff and strict quality control methods enable us to produce products with an exceptional reputation for reliability and efficiency, maintained over many years. As well as CE certification and ISO 9001, several products ranges have UL / ETL safety approval in the USA and Canada, Eurovent performance and sound certification as well as ROHS compliance for Europe, giving you the confidence of knowing our company is the right choice when selecting fan coil units.

ALWAYS MAKE SURE THIS MANUAL REMAINS WITH THE UNIT. READ THIS MANUAL BEFORE PERFORMING ANY OPERATION ON THE UNIT.

Table of Contents

A. Technical Data	4
A.1. General Description.....	4
A.2. General Specifications.....	5
A.2.1. 2-pipe Systems.....	5
A.3. Coil Data.....	7
A.4. Dimensional Drawings	7
A.5. Sound power data.....	9
A.6. Drain Pump and Installation Fixture (Optional).....	13
B. Installation.....	14
B.1. Safety Precautions.....	14
B.2. Before Installation.....	15
B.3. Mounting Plate Dimensions.....	16
B.4. Mounting Plate Installation.....	17
B.5. Condensate Drainage Hole Drilling	17
B.6. Hydronic Unit Installation.....	18
B.7. Drainage Piping Works.....	18
B.8. Pipe Connections with Valve.....	19
C. Maintenance.....	20
C.1. Opening and Closing of Lift-Up Grille Cover.....	20
C.2. Front Cover Assembly Removal.....	20
C.3. Air Vent and Water Purge Valves.....	20
C.4. Wiring Connections	20
D. Control Specifications: Intelligent Control (I TYPE).....	21
D.1. I/O Port Definitions	21
D.2. Wiring Diagrams.....	22
D.3. Control Logics For 2-Pipe System	23
D.3.1. With Thermoelectric Valve Configuration	23
D.3.2. 2-pipe Control Logic -With 6-way modulating Valve Configuration	26
D.4. Sleep Mode.....	28
D.5. Louver	28
D.6. Buzzer.....	28
D.7. Auto Restart	28
D.8. On/Off Switch.....	28

<i>D.9. Drain Pump</i>	28
<i>D.10. Float Switch</i>	28
<i>D.11. Electric Heater Safety Switch</i>	29
<i>D.12. Low Temperature Protection of Indoor Coil in Winter</i>	29
<i>D.13. Network Setup</i>	30
<i>D.14. Open Modbus Protocol</i>	32
<i>D.15. LED Display and Error Description</i>	36
E. Control Specification: Flexible Function PCB – W Type Control	38
<i>E.1. I/O Port Definitions</i>	38
<i>E.2. Wiring diagram</i>	39
<i>E.3. Onboard configuration</i>	40
<i>E.4. Control Logics</i>	41
<i>E.5. LED Display and Error Description</i>	41
F. Users Interface	42
<i>F.1. Remote Control Handset</i>	42
G. Wired Wall Pad Controller Operation Guide	43
<i>G.1. LED display</i>	43
<i>G.2. Dimensions and installation</i>	44
<i>G.3. Operation guide</i>	45
<i>G.4. Error codes</i>	49
H. Sensor Resistance R-T Conversion Table	50
I. Troubleshooting	52

Model Code Nomenclature

<u>1</u>	<u>2</u>	<u>3</u>	<u>4</u>	<u>5</u>
<u>SWC</u>	<u>-06</u>	<u>-V</u>	<u>-I</u>	<u>-EC</u>

Notation		Description
1	SWC	Hydronic High-Wall C Series
2	06	Unit Size (See General Specification Section A for cooling and heating capacities.)
3	V	V – 2-pipe
4	I	Control type: I – Intelligent Control W – Flexible function Control
5	EC	EC Motor

A. Technical Data

A.1. General Description

This High-Wall Unit is designed to meet and exceed demanding requirements for efficiency, quiet operation and appearance. The sleek profile and elegantly styled cabinet complement interior design theme, while the microprocessor assures accurate environmental control.

Cabinet ~ the stylish cabinet is constructed of durable flame-resistant acrylonitrile-butadiene-styrene (ABS) plastic. The silver white color and rounded corners provide its modern look.

Water Coil ~ the water coil has a large heat transfer surface and utilizes the latest fin profile technology. It combines an advanced technology approach with the security of a traditional design regarding tube thickness. The coil is constructed with seamless copper tubes and headers. The tubes are mechanically expanded into corrugated aluminum fin material for a permanent primary to secondary surface bond. The coil is tested at 35 bar and recommended for operating at 20 bar (excluding flexible hoses). It includes manual air vent and water purge valve.

Integral Hoses ~ an integral hose is a synthetic elastomer tube, with stainless steel outer braiding and brass connectors, which enables quick, low-cost connections with no brazing.

Blower and Motor ~ the unit incorporates only specially designed and tested EC motors, allowing the blower wheel to provide optimum performance in airflow-efficiency and quiet operation.

Filters ~ washable, easy-to-remove, fine mesh air filters are standard to all high-wall models. Tabs located on the front of the unit can be unsnapped, allowing the filter to be easily slid downward and removed. No tools are required, nor any dismantling of the equipment.

Air Grille Distribution ~ all units are equipped with both deflector blades and independent directional vanes, enabling supply air to be automatically distributed, and air flow and direction to be customized.

CONTROL SYSTEMS

1. Intelligent control (I type)

Intelligent control board is controlled via Infra-red handset and/or Intelligent wired wall pad, is field programmable and easy to be configured through the wired wall pad or open Modbus protocol with VVW and VAV control logics, provides variable speed indoor fan control, integrates with Intelligent modulating valves to allow Auto Dynamic Balancing and Intelligent Constant Delta T management systems. It controls 2-pipe, 2-pipe with electric heater, 2-pipe with 6-way valve and 4-pipe systems.

2. Flexible control (W type)

This control options features flexible functionality for external thermostat applications, allowing the independent control of drain pumps (if equipped), offering zone control operations, and limited diagnostics. In products where louvers are required, this control allows the stepping motors to open the louver at maximum position or close them when power of the unit is OFF.



A.2. General Specifications

A.2.1. 2-pipe Systems

Product range: SWC-ECM Hydronic High Wall Unit with EC Motor

Unit Configuration		SWC-[Size]-V-ECM		04	06C	12B	15B	
		Configuration		2-pipe				
		Number Of Fan Blowers		Single				
		Power Supply	(V/Ph/Hz)	220-240/1/50-60				
Performance Data	Air	Air Flow	H	m ³ /hr	370	500	500	645
			M		290	370	370	500
			L		220	290	290	370
	Cooling	Cooling Capacity ^e	H	kW	1	1.82	2.10	3.01
			M		0.84	1.43	1.62	2.47
			L		0.68	1.21	1.42	1.86
		Sensible Cooling Capacity ^e	H		0.85	1.53	1.81	2.22
			M		0.71	1.2	1.34	1.81
			L		0.57	1	1.15	1.35
		Latent Cooling Capacity	H		0.15	0.29	0.29	0.79
			M		0.13	0.23	0.28	0.66
		FCEER ^e	Rating Class		107.83	115.62	171.07	173.6
	Class		C	C	B	B		
	Heating	Heating Capacity ^e	H	kW	1.2	2.23	2.65	3.25
			M		1	1.76	2.07	2.65
			L		0.82	1.38	1.69	2.07
		Max. Electric Heater Capacity			1			
	FCCOP ^e		Rating Class		132.93	136.1	209.49	191.9
	Class		Class		C	C	B	B
	Sound	Sound Pressure Level(Outlet)		dB(A)	34/29/24	39/31/26	40/33/28	45/34/31
		Sound Power Level (Outlet) ^e			42/38/33	45/35/33	49/42/37	54/43/40
	Electrical	Power input in cooling mode ^e	H	W	13	18	13	22
			M		10	13	10	15
			L		5	10	8	10
Power input in heating mode ^e		H	W	13	18	13	22	
		M		10	13	10	15	
		L		5	10	8	10	
Fan Motor Running Current @ H		A	0.11	0.16	0.11	0.19		
Hydraulic	Cooling Water Flow Rate	H	L/h	171	313	361	517	
		M		143	246	279	423	
		L		116	208	244	319	
	Cooling Pressure Drop ^e	H	kPa	22.8	28.8	27.5	38.5	
		M		16.8	18.7	16.6	27.5	
		L		11.8	11.8	13.2	15.6	
	Heating Water Flow Rate	H	L/h	206	384	456	559	
		M		172	301	356	456	
		L		141	237	291	356	
	Heating Pressure Drop ^e	H	kPa	18.4	29.4	29.0	38.9	
M		13.6		18.9	17.8	27.6		
L		9.4		11.7	12.8	16.5		
Water Content		L	0.045	0.0789	0.124	0.124		
Construction and Packing Data	Water Connections	Type		Socket (Threaded Female)				
		In	mm [in]	12.7 [1/2]				
	Out	16 [5/8]						
	Condensate Drainage Connection		16 [5/8]					
	Dimensions	L	mm	876				
		W		228				
H		300						
Net Weight		kg	11	12	13	13		

^e: Above specifications are based on declared Eurovent test data for the year of publication of this document. To confirm the most updated specifications, please visit www.eurovent-certification.com.

Eurovent testing conditions:

a. Cooling mode (2-pipe):

- Return air temperature: 27C DB/ 19C WB.
- Inlet/ Outlet water temperature: 7C/ 12C.

b. Heating mode (2-pipe):

- Return air temperature: 20C.
- Inlet/ Outlet water temperature: 45C/ 40C.


Product range: SWC-ECM Hydronic High Wall with EC Motor

		SWC-[Size]-V~-ECM		18	20	24B	30
Unit Configuration	Configuration		2-pipe				
	Number Of Fan Blowers		Single				
Performance Data	Power Supply		220-240/1/50-60				
	(V/Ph/Hz)						
Performance Data	Air	Air Flow	H	788	980	1080	1240
			M	740	760	980	1080
			L	570	600	600	760
	Cooling	Cooling Capacity ^e	H	3.71	4.81	5.33	5.93
			M	3.26	3.9	4.78	5.12
			L	2.66	3.35	3.33	3.88
		Sensible Cooling Capacity ^e	H	2.74	3.46	3.88	4.34
			M	2.4	2.8	3.46	3.73
			L	1.94	2.38	2.38	2.8
		Latent Cooling Capacity	H	0.97	1.35	1.45	1.59
			M	0.86	1.1	1.32	1.39
			L	0.72	0.97	0.95	1.08
	FCEER ^e	Rating		181.35	208	165.52	141.61
			Class	B	A	B	B
	Heating	Heating Capacity ^e	H	4.06	5.21	5.34	5.93
			M	3.86	4.23	4.95	5.34
			L	3.12	3.48	3.48	4.23
		Max. Electric Heater Capacity		1.2			
FCCOP ^e		Rating		214.87	220.82	172.83	153.08
		Class	B	B	B	C	
Sound	Sound Pressure Level(Outlet)		49/44/37				
	Sound Power Level (Outlet) ^e		58/53/46				
Electrical	Power input in cooling mode ^e	H	30	30	40	50	
		M	20	20	30	40	
		L	13	15	19	25	
	Power input in heating mode ^e	H	30	30	40	50	
		M	20	20	30	40	
		L	13	15	19	25	
Fan Motor Running Current @ H		A	0.26	0.26	0.35	0.43	
Hydraulic	Cooling Water Flow Rate	H	638	827	917	1020	
		M	559	671	822	881	
		L	456	576	573	667	
	Cooling Pressure Drop ^e	H	50	59.5	52.5	63.3	
		M	40	42.7	43.5	49.3	
		L	28	32.2	23.5	30.5	
	Heating Water Flow Rate	H	698	896	916	1012	
		M	664	728	848	916	
		L	537	599	599	728	
	Heating Pressure Drop ^e	H	51.5	58.4	26.7	32	
M		46.4	41.9	23.3	26.7		
L		32.1	31.6	22.6	31.3		
Water Content		L	0.192	0.252	0.252	0.252	
Construction and Packing Data	Water Connections	Type		Socket (Threaded Female)			
		In	12.7 [1/2]				
	Condensate Drainage Connection		16 [5/8]				
	Dimensions	L	876		1063		
		W	228		240		
		H	300		310		
Net Weight		kg	14	16	16	16	

"e": Above specifications are based on the published Eurovent test data of the year of publication of this document. To confirm the most updated specifications please visit www.eurovent-certification.com.

Eurovent testing conditions:

a. Cooling mode (2-pipe):

- Return air temperature: 27C DB/ 19C WB.
- Inlet/ Outlet water temperature: 7C/ 12C.

b. Heating mode (2-pipe):


- Return air temperature: 20C.
- Inlet/ Outlet water temperature: 45C/ 40C.

A.3. Coil Data

Model	Fin Height (mm.)	Fin Length (mm.)	Fins per Inch	No. of Rows	No. of Copper	No. of Circuits	Tube Diameter (mm)
SWC-04	230	680	19.5	2	8	2	7
SWC-06	230	680		2	14	3	7
SWC-12	230	680		2	22	4	7
SWC-15	230	680		2	22	4	7
SWC-18	357	680		2	34	5	7
SWC-20	378	845		2	36	6	7
SWC-24	378	845		2	36	6	7
SWC-30	378	845		2	36	6	7

A.4. Dimensional Drawings

Dimensional drawing for SWC-04/06/12/15/18-ECM



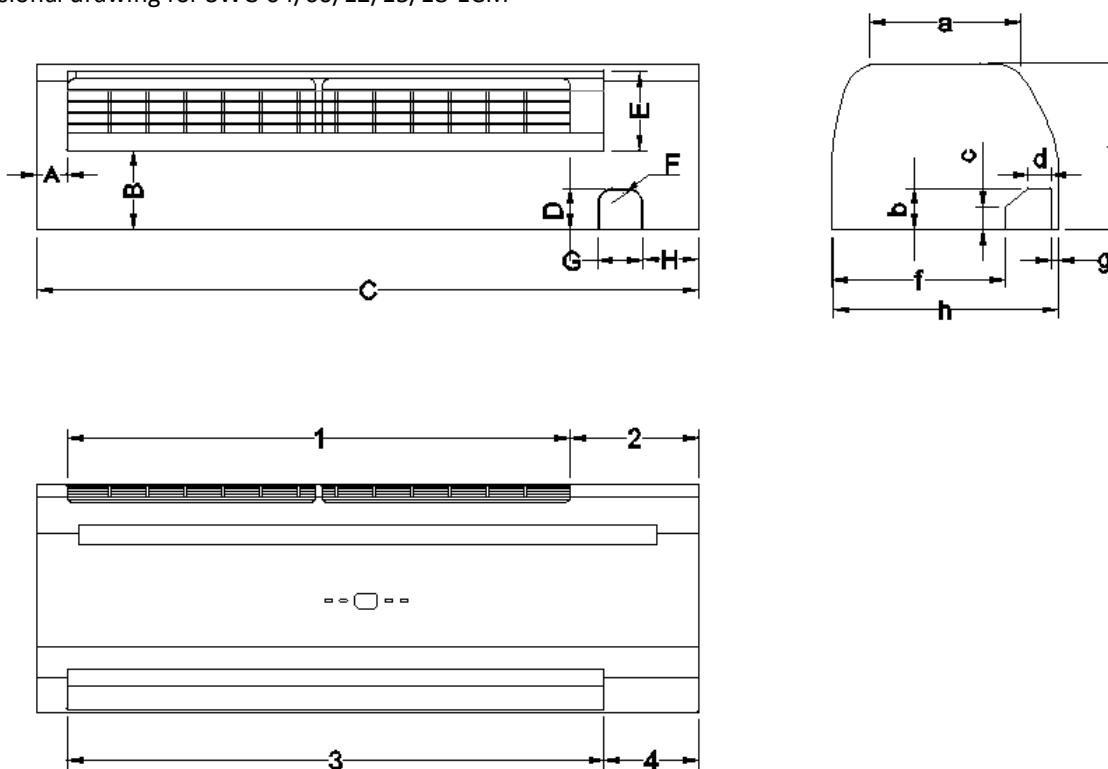


Model	Unit Dimensions (mm)							
	A	B	C	D	E	F	G	H
SWC-04/06/12/15/18	40	105	875	55	105	R20	60	74

Model	Unit Dimensions (mm)							
	a	b	c	d	e	f	g	h
SWC-04/06/12/15/18	200	55	30	30	220	229	10	300

Model	Unit Dimensions (mm)			
	1	2	3	4
SWC-04/06/12/15/18	665	170	710	125

Dimensional drawing for SWC-20/24/30-ECM

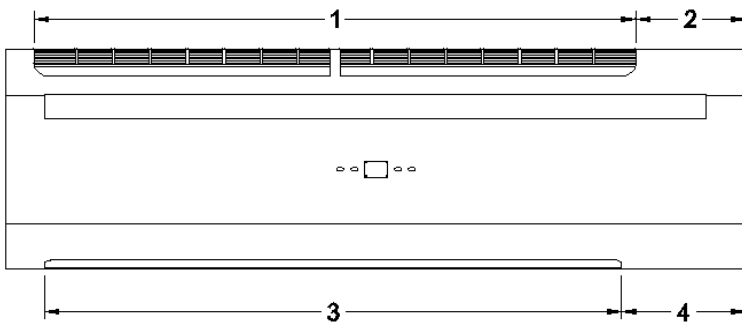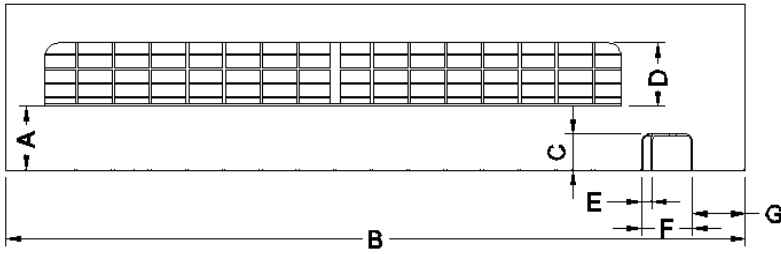

Model	Unit Dimensions (mm)						
	A	B	C	D	E	F	G
SWC-20/24/30	90	1050	51	90	15	73	74

Model	Unit Dimensions (mm)							
	a	b	c	d	e	f	g	h
SWC-20/24/30	215	52	30	32	235	310	58	13

Model	Unit Dimensions (mm)			
	1	2	3	4
SWC-20/24/30	855	155	820	175

A.5. Sound power data

Model	SWC-04-ECM			SWC-06-ECM			SWC-12-ECM			SWC-15-ECM			SWC-18-ECM			
Speed	H(700)	M(600)	L(500)	H(930)	M(700)	L(600)	H(930)	M(700)	L(600)	H(1150)	M(800)	L(700)	H(1300)	M(1100)	L(900)	
Sound Power dB(A)	39.4	36.2	36.2	49.0	39.8	35.7	49.0	39.8	35.5	56.0	43.9	39.5	60.0	54.5	47.5	
Sound Power in 1/3 Octave-bands under ESP: 0 Pa (dB)	20.0 Hz	23.7	20.1	16.5	15.8	19.8	17.1	15.8	17.4	18.3	21.1	19.9	19.9	14.7	23.8	19.0
	25.0 Hz	22.1	15.3	15.7	14.0	19.5	17.2	18.4	19.3	19.0	22.6	19.7	17.7	21.4	17.9	17.9
	31.5 Hz	22.3	14.7	18.3	23.2	16.6	21.8	19.6	22.2	15.3	22.7	16.3	18.4	21.2	17.9	19.1
	40.0 Hz	16.1	15.2	16.8	19.9	14.8	13.4	17.9	13.4	13.9	23.6	16.3	17.6	28.1	19.1	17.6
	50.0 Hz	16.9	17.3	17.8	22.0	17.8	16.6	20.8	20.2	20.2	20.3	20.2	18.9	23.2	26.0	20.8
	63.0 Hz	20.5	17.7	13.4	24.7	19.8	16.7	25.2	17.6	16.0	28.4	23.4	20.8	34.4	29.1	23.3
	80.0 Hz	17.2	16.9	9.8	26.1	20.3	12.4	27.2	19.8	16.4	32.1	21.0	21.8	38.8	31.2	26.0
	100.0 Hz	20.1	16.8	31.9	28.6	22.8	17.7	28.3	22.9	16.3	36.0	24.2	22.1	39.4	37.2	27.6
	125.0 Hz	23.5	27.8	14.6	32.1	26.3	25.9	27.7	25.9	25.9	38.0	27.3	26.3	43.2	34.6	28.8
	160.0 Hz	24.5	20.9	16.3	34.4	26.1	17.8	31.5	25.8	20.0	39.8	30.0	23.4	44.5	37.0	31.8
	200.0 Hz	23.5	19.5	16.1	33.2	26.0	17.7	31.0	22.3	19.2	39.2	29.6	23.9	44.6	37.5	31.3
	250.0 Hz	24.2	20.7	16.3	31.7	25.0	20.0	32.4	24.8	20.0	39.6	28.1	26.5	43.5	36.9	30.8
	315.0 Hz	26.0	23.3	21.8	35.2	25.6	22.1	34.0	25.0	22.4	40.9	30.5	25.7	45.0	40.4	34.3
	400.0 Hz	33.0	26.4	21.3	39.9	32.0	26.2	39.7	32.3	25.8	46.2	36.2	31.7	50.5	45.1	38.0
	500.0 Hz	32.0	24.5	25.4	42.3	31.1	25.1	43.1	31.7	25.4	47.5	37.9	32.4	50.9	46.3	41.3
	630.0 Hz	30.5	26.0	21.4	42.2	29.7	24.6	41.6	30.0	24.2	48.8	35.4	30.7	52.3	49.5	39.7
	800.0 Hz	27.1	22.8	18.0	37.6	27.9	22.6	38.0	27.5	21.3	46.5	32.8	28.2	50.8	44.4	37.2
	1000.0 Hz	28.4	22.9	20.2	39.5	28.6	23.1	40.2	27.8	22.9	48.5	33.6	28.8	52.6	45.7	39.1
	1250.0 Hz	25.0	21.0	19.6	36.3	24.7	21.0	36.2	24.7	20.9	45.2	30.5	24.3	49.1	43.9	35.0
	1600.0 Hz	23.3	22.4	20.7	32.8	22.6	21.6	33.0	22.8	21.6	42.7	26.7	22.8	47.1	39.4	31.3
2000.0 Hz	20.6	20.0	19.4	29.6	20.8	19.8	30.0	20.7	19.6	39.4	23.4	21.2	44.4	36.8	28.0	
2500.0 Hz	20.6	20.0	19.8	26.9	20.9	20.0	27.5	20.4	20.3	36.7	22.2	20.4	41.6	34.1	25.9	
3150.0 Hz	21.0	20.6	20.6	24.5	20.9	20.7	25.0	21.0	20.6	33.3	21.9	20.9	38.3	31.3	23.7	
4000.0 Hz	20.7	20.5	20.8	23.1	20.8	20.8	23.6	20.6	20.6	31.5	21.3	20.7	36.6	29.5	22.9	
5000.0 Hz	20.7	20.8	20.5	21.8	20.7	20.6	22.0	20.7	20.5	27.8	20.9	20.6	32.7	25.9	21.6	
6300.0 Hz	20.4	20.2	20.1	20.5	20.2	20.0	20.6	20.2	20.1	24.5	20.3	20.2	29.1	23.1	20.4	
8000.0 Hz	19.2	19.2	19.3	19.2	19.2	19.1	19.3	19.1	19.2	21.2	19.2	19.1	24.6	20.5	19.3	
10000.0 Hz	17.3	17.3	17.4	17.2	17.5	17.3	17.3	17.4	17.2	17.9	17.3	17.2	19.5	17.7	17.3	
12500.0 Hz	14.4	14.3	14.5	14.3	14.5	14.4	14.4	14.5	14.3	14.6	14.4	14.5	15.3	14.5	14.4	
16000.0 Hz	11.3	11.4	11.1	11.6	11.2	11.2	11.5	11.2	11.3	11.9	11.3	11.3	11.9	11.4	11.6	

Model	SWC-04-18														
Speed	100RPM	200RPM	300RPM	400RPM	500RPM	600RPM	700RPM	800RPM	900RPM	1000RPM	1100RPM	1200RPM	1300RPM	1400RPM	
Sound Power dB(A)	32.2	32.3	32.8	33.1	35.2	35.6	39.1	43.5	47.4	50.6	53.7	56.2	59.3	61.3	
Sound Power in 1/3 Octave-bands under ESP: 0 Pa (dB)	20.0 Hz	18.0	19.7	14.7	16.7	21.1	16.3	18.6	21.5	18.5	22.1	20.5	22.3	19.8	21.3
	25.0 Hz	18.8	17.9	17.6	17.6	17.2	18.2	22.7	22.0	17.8	19.4	16.7	18.5	20.0	15.1
	31.5 Hz	15.3	21.5	25.1	17.1	21.8	15.6	19.0	18.3	21.8	19.1	20.5	18.4	17.8	14.8
	40.0 Hz	14.3	15.2	15.5	16.7	14.7	14.4	12.7	18.5	15.8	16.3	20.7	23.5	23.2	22.6
	50.0 Hz	17.3	17.7	18.3	19.4	15.7	18.6	16.1	18.8	20.5	21.5	21.4	23.8	26.2	28.7
	63.0 Hz	12.1	11.2	19.2	16.6	12.9	17.6	20.3	17.8	23.1	27.5	27.9	26.6	31.6	34.0
	80.0 Hz	9.8	10.9	10.1	23.5	13.7	13.9	18.8	23.2	23.0	23.1	32.4	33.7	37.8	35.8
	100.0 Hz	18.4	19.4	13.1	12.8	34.6	16.5	18.4	22.2	26.2	27.2	35.6	38.1	40.5	39.5
	125.0 Hz	11.6	12.6	17.6	10.6	16.3	25.9	25.4	23.7	27.8	29.7	35.5	36.6	42.7	43.7
	160.0 Hz	14.9	11.4	12.5	15.1	15.3	22.5	25.0	27.9	30.3	34.8	37.9	38.9	41.4	45.1
	200.0 Hz	13.5	14.2	13.3	14.2	18.1	19.0	22.9	27.4	30.0	35.9	37.3	41.0	41.1	44.9
	250.0 Hz	11.4	12.8	10.8	16.0	16.3	20.4	22.5	26.8	29.9	33.8	36.5	39.5	42.3	46.0
	315.0 Hz	11.7	12.9	11.6	13.6	24.1	21.7	25.3	31.5	32.9	37.1	39.3	42.6	45.4	47.2
	400.0 Hz	13.7	14.0	12.7	15.8	22.8	26.4	31.5	35.7	38.4	40.1	43.7	46.2	49.6	52.5
	500.0 Hz	15.0	15.4	14.3	16.0	21.7	24.8	32.1	37.2	42.2	42.5	45.4	47.6	49.8	51.7
	630.0 Hz	17.4	16.3	16.1	17.1	21.2	24.2	29.8	34.6	40.0	45.1	47.8	48.9	50.7	52.3
	800.0 Hz	16.4	16.2	16.8	18.1	20.4	22.2	27.0	31.3	36.6	40.1	44.1	48.3	50.1	52.3
	1000.0 Hz	17.3	17.1	18.0	20.0	23.4	22.7	28.0	32.7	37.6	41.0	44.5	48.1	51.1	53.7
	1250.0 Hz	18.8	18.4	19.6	20.9	22.7	21.4	23.9	28.8	34.5	38.3	41.7	45.0	47.7	50.2
	1600.0 Hz	18.8	19.1	18.8	20.2	21.4	21.1	22.2	26.0	30.7	34.6	38.5	43.0	45.7	48.8
2000.0 Hz	19.2	19.8	20.1	19.9	20.9	19.9	20.9	23.1	27.6	32.4	36.5	39.7	43.0	46.2	
2500.0 Hz	19.6	20.0	19.9	19.8	20.3	20.2	20.6	21.6	25.0	28.8	33.2	37.4	40.5	43.6	
3150.0 Hz	20.2	20.4	20.3	20.1	20.6	20.7	21.1	21.2	23.4	26.0	30.3	33.6	37.0	40.5	
4000.0 Hz	20.4	20.4	20.4	20.8	20.4	20.7	20.8	21.0	22.6	24.6	28.9	32.8	36.3	39.5	
5000.0 Hz	20.4	20.6	20.4	20.5	20.6	20.5	20.6	21.0	21.4	22.7	25.3	28.8	32.0	35.6	
6300.0 Hz	20.3	20.2	20.1	20.3	20.4	20.2	20.1	20.5	20.5	20.9	22.5	25.1	28.3	31.4	
8000.0 Hz	19.1	19.2	19.2	19.1	19.1	19.2	19.2	19.1	19.2	19.2	20.0	21.6	23.8	27.1	
10000.0 Hz	17.5	17.4	17.3	17.6	17.4	17.3	17.3	17.3	17.3	17.5	17.7	18.0	19.1	20.9	
12500.0 Hz	14.6	14.5	14.4	15.1	15.1	14.3	14.2	15.8	14.4	14.3	14.6	14.7	15.3	17.1	
16000.0 Hz	11.0	11.1	11.0	15.2	15.6	11.2	11.2	25.1	11.6	11.5	11.5	12.0	12.1	12.8	

Model	SWC-20-ECM			SWC-24-ECM			SWC-30-ECM			
Speed	H(1100)	M(900)	L(800)	H(1200)	M(1100)	L(900)	H(1350)	M(1200)	L(900)	
Sound Power dB(A)	53.8	49.2	44.6	57.3	53.8	49.4	60.3	56.9	49.4	
Sound Power in 1/3 Octave-bands under ESP: 0 Pa (dB)	20.0 Hz	21.2	18.3	22.8	22.5	17.0	17.0	20.8	19.9	17.0
	25.0 Hz	18.7	20.6	24.2	20.4	16.2	20.5	21.4	19.1	20.5
	31.5 Hz	20.4	17.5	16.1	20.1	16.7	17.5	17.6	15.2	17.5
	40.0 Hz	21.3	12.9	17.3	21.8	18.7	16.2	23.2	24.3	16.2
	50.0 Hz	20.8	19.4	15.0	21.7	25.4	18.0	25.5	22.4	18.0
	63.0 Hz	27.1	22.1	18.7	25.6	27.8	23.2	29.0	28.9	23.2
	80.0 Hz	30.8	25.2	21.6	32.6	30.0	23.5	35.4	31.4	23.5
	100.0 Hz	31.4	29.2	22.6	34.6	31.3	27.9	37.0	34.3	27.9
	125.0 Hz	34.0	28.0	25.2	37.5	32.2	29.2	39.8	36.3	29.2
	160.0 Hz	33.0	30.1	27.6	37.3	36.6	32.2	43.4	38.3	32.2
	200.0 Hz	35.9	33.5	30.8	40.9	36.6	35.2	43.1	38.9	35.2
	250.0 Hz	39.3	32.6	28.4	39.7	38.5	34.0	41.4	39.8	34.0
	315.0 Hz	40.0	42.4	36.7	43.9	39.6	41.4	46.4	43.2	41.4
	400.0 Hz	42.6	38.7	34.8	46.6	42.8	39.5	50.1	46.1	39.5
	500.0 Hz	43.6	40.5	35.8	47.8	45.0	40.6	50.5	46.3	40.6
	630.0 Hz	47.0	41.1	36.5	49.6	46.9	40.8	52.3	49.8	40.8
	800.0 Hz	47.2	40.4	35.9	51.4	46.4	41.7	53.1	50.3	41.7
	1000.0 Hz	43.6	37.1	32.8	47.4	43.7	38.1	50.7	47.2	38.1
	1250.0 Hz	43.3	38.1	31.8	48.7	43.0	37.7	50.3	47.4	37.7
	1600.0 Hz	38.6	31.6	27.7	43.1	39.4	31.9	46.9	42.3	31.9
	2000.0 Hz	37.0	28.9	25.7	41.8	37.6	29.3	46.1	41.6	29.3
	2500.0 Hz	32.6	25.2	23.9	37.0	32.5	25.5	41.9	37.0	25.5
	3150.0 Hz	30.9	24.0	22.1	36.5	31.1	24.3	41.2	35.8	24.3
	4000.0 Hz	27.2	22.0	21.7	31.5	27.5	22.3	37.3	31.8	22.3
5000.0 Hz	24.1	21.1	21.2	28.0	24.2	21.3	33.5	28.3	21.3	
6300.0 Hz	22.6	20.8	21.9	24.3	22.4	20.6	29.2	24.8	20.6	
8000.0 Hz	19.8	19.6	19.2	20.9	20.0	19.5	25.2	21.4	19.5	
10000.0 Hz	17.6	17.4	17.5	17.9	17.6	17.4	19.5	18.0	17.4	
12500.0 Hz	14.6	14.6	16.0	14.7	14.6	14.6	15.2	14.7	14.6	
16000.0 Hz	11.8	11.9	18.0	12.1	11.9	11.7	12.3	12.1	11.7	

Model	SWC-20-24-30														
Speed	100RPM	200RPM	300RPM	400RPM	500RPM	600RPM	700RPM	800RPM	900RPM	1000RPM	1100RPM	1200RPM	1300RPM	1400RPM	
Sound Power dB(A)	32.7	32.3	33.0	34.6	35.2	36.9	40.2	45.1	48.6	51.8	54.3	56.9	59.2	61.3	
Sound Power in 1/3 Octave-bands under ESP: 0 Pa (dB)	20.0 Hz	19.4	19.5	20.8	20.0	18.9	19.8	17.0	19.9	15.5	20.0	21.2	19.9	19.1	22.5
	25.0 Hz	20.5	17.9	20.7	21.4	20.7	18.4	17.1	22.3	19.9	21.9	20.2	19.1	18.9	24.0
	31.5 Hz	19.8	16.2	17.0	20.4	15.6	17.7	19.5	20.9	15.6	13.3	18.0	15.2	19.2	16.1
	40.0 Hz	14.3	13.2	17.0	24.9	14.0	17.8	18.6	20.3	19.0	16.5	19.0	24.3	24.8	21.5
	50.0 Hz	19.0	15.8	18.7	17.0	18.3	16.9	17.9	20.3	17.2	18.8	22.3	22.4	25.0	26.0
	63.0 Hz	16.2	15.1	18.5	18.6	19.5	19.2	18.5	18.2	19.5	24.3	25.8	28.9	28.0	30.0
	80.0 Hz	12.7	14.8	12.5	24.9	12.0	13.2	17.1	20.7	24.1	28.5	33.2	31.4	35.3	35.4
	100.0 Hz	14.4	14.5	12.0	16.2	25.7	17.8	20.7	23.0	28.7	27.4	33.7	34.3	36.4	37.6
	125.0 Hz	10.7	12.1	17.7	16.0	18.9	20.9	23.2	24.9	28.3	33.9	34.8	36.3	36.8	42.9
	160.0 Hz	12.3	13.1	12.4	20.5	17.7	24.2	27.0	30.0	31.4	31.8	35.1	38.3	42.6	44.2
	200.0 Hz	13.5	13.6	12.5	13.5	23.2	21.6	29.6	34.2	34.6	35.1	38.8	38.9	43.0	43.3
	250.0 Hz	11.5	12.8	11.0	13.4	15.0	24.8	29.2	29.4	33.9	37.8	38.3	39.8	41.5	41.3
	315.0 Hz	13.8	12.7	15.0	18.3	19.2	22.7	29.4	36.2	40.0	36.5	40.9	43.2	46.0	46.9
	400.0 Hz	15.3	15.6	15.6	17.1	21.7	25.9	31.0	33.9	38.2	41.0	44.3	46.1	49.1	51.1
	500.0 Hz	17.3	15.9	16.2	19.6	19.9	26.0	31.5	37.3	40.0	42.1	44.2	46.3	49.3	51.8
	630.0 Hz	18.0	17.8	17.2	21.5	20.3	26.3	31.7	36.6	40.7	45.1	47.5	49.8	51.3	53.3
	800.0 Hz	17.4	17.8	18.0	21.7	21.6	26.2	31.4	35.9	40.6	45.1	47.3	50.3	51.8	54.5
	1000.0 Hz	18.2	18.5	19.6	21.7	21.5	24.7	28.7	32.9	37.6	41.6	44.4	47.2	49.4	52.1
	1250.0 Hz	19.2	19.1	20.7	21.6	24.5	26.0	28.6	32.7	36.0	41.2	44.2	47.4	49.2	51.4
	1600.0 Hz	18.7	18.8	18.9	19.2	20.4	21.3	23.5	27.1	31.3	35.8	39.5	42.3	45.5	48.3
2000.0 Hz	19.7	19.4	19.5	19.9	20.0	20.8	21.8	25.6	29.6	34.1	37.6	41.6	44.9	47.3	
2500.0 Hz	19.6	19.7	19.7	19.9	20.0	20.2	20.8	22.7	25.6	29.8	33.6	37.0	40.2	43.5	
3150.0 Hz	20.2	20.3	20.1	20.3	20.3	20.8	21.0	22.1	24.0	27.8	31.6	35.8	39.6	42.8	
4000.0 Hz	20.6	20.5	20.6	20.3	20.7	20.7	21.0	21.2	22.4	24.6	28.1	31.8	35.6	39.1	
5000.0 Hz	20.3	20.6	20.5	20.6	20.7	20.5	20.7	20.8	21.2	22.7	24.8	28.3	31.7	35.3	
6300.0 Hz	20.2	20.2	20.1	20.2	20.4	20.3	20.6	20.6	20.3	21.3	22.6	24.8	27.4	31.0	
8000.0 Hz	19.4	19.5	19.3	19.3	19.6	19.3	19.2	19.2	19.4	19.8	19.9	21.4	23.5	26.8	
10000.0 Hz	17.5	17.6	17.5	17.5	17.5	17.5	17.5	17.5	17.4	17.4	17.6	18.0	18.7	20.2	
12500.0 Hz	14.6	14.6	14.7	14.7	14.6	14.7	14.6	14.6	14.6	14.6	16.4	14.7	14.9	15.5	
16000.0 Hz	11.7	11.6	11.7	11.7	11.8	11.9	11.7	11.9	11.9	11.9	24.6	12.1	12.3	12.4	

A.6. Drain Pump and Installation Fixture (Optional)

Upon request, the metal bracket for fixing the drain pump and drain pump kits can be offered and preinstalled as optional. Please consult our sales representatives for these optional accessories.



Sauermann condensate drain pump kits (optional)



Metal bracket for fixing the drain pump on the unit (optional)

B. Installation

B.1. Safety Precautions

- When installing, performing maintenance or servicing Polar Air fan coil units observe the precautions stated in this manual as well as those stated on the labels attached to the unit.
- Ensure all local and national safety codes, laws, regulations, as well as general electrical and mechanical safety guidelines are followed for installation, maintenance and service.
- The appliance is for indoor use only.
- Ensure the correct power supply is provided.
- If the power supply cord is damaged, it must be replaced by qualified personnel.
- Installing and servicing fan coil unit should be performed by qualified service personnel only.
- This appliance is not intended for use by persons (including children) with reduced physical, sensory or mental capabilities, or persons lacking in experience and knowledge of the appliance, unless they have been given supervision or instruction concerning it.
- User of this appliance is responsible for his/her own safety.
- Warranty shall be voided if installation instructions and safety precaution stated in this manual are not observed.
- Never cut off the mains supply when unit is under operation. The unit should only be switched off by using the ON-OFF button on the control interface.
- During connections, select pipe pliers according to pipe diameter to avoid damaging units over forced.
- Untreated frozen water and cooling water may cause dirt accumulation and corrosion. Suggest using treated water. Suggested working water pressure is below 1.6 Mpa.
- When units are in cooling mode, suggested freezing water degree is $\geq 7^{\circ}\text{C}$; When units are in heating mode, suggested hot water degree is $\leq 60^{\circ}\text{C}$.
- Condensate water pipe, water connection pipe, water connectors and solenoid valve body must remain heat to avoid condensation.

CAUTIONS


Before any service or maintenance operations turn off the mains electrical supply.

DO NOT turn OFF the main power supply when the unit is operating. Turn off the unit BEFORE turning off the main power

B.2. Before Installation

Select the location for the high-wall unit with the following considerations:

1. The air inlet and outlet area should be clear without obstructions. The air should flow freely.
2. The high wall unit should be mounted on solid wall.
3. The location should allow easy access to connect water pipes easily achieve drainage.
4. Ensure the clearance around the fan coil unit conforms to the following drawing.

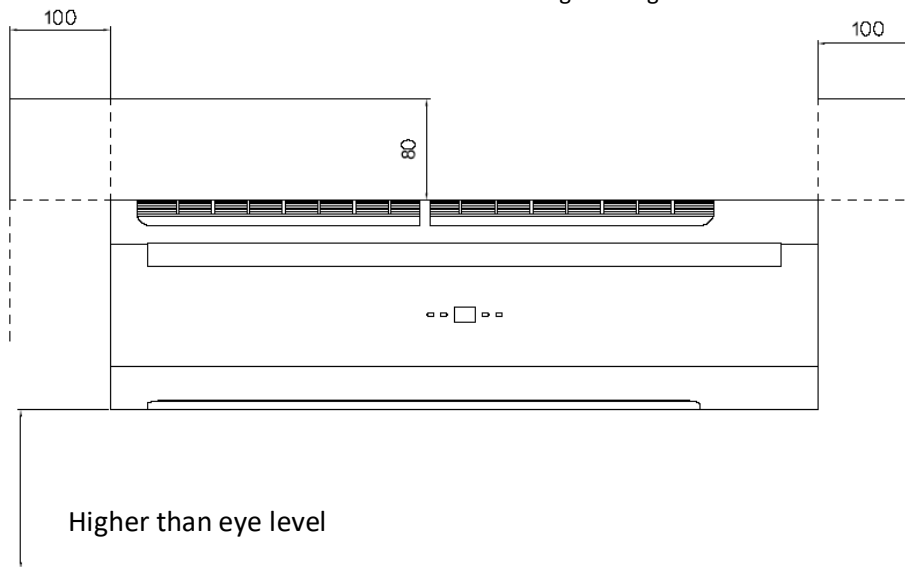


* Required clearance for maintenance and servicing is as shown above.

** All dimensions shown in mm.


5. The unit should be installed higher than eye level.
6. Avoid installing the unit with direct sunlight.
7. The signal receiver on the unit must be kept away from any high frequency emission source.
8. Keep the unit away from fluorescent lamps, which may affect the control system.
9. Avoid electromagnetic control system interference, ensure control wires are installed separately from 110-240 VAC power supply wires.
10. Use shielded sensor cables in where electromagnetic waves present.
11. Install a noise filter if the power supply creates any disruptive noises.

B.3. Mounting Plate Dimensions

SWC-04/06/12/15/18 –ECM

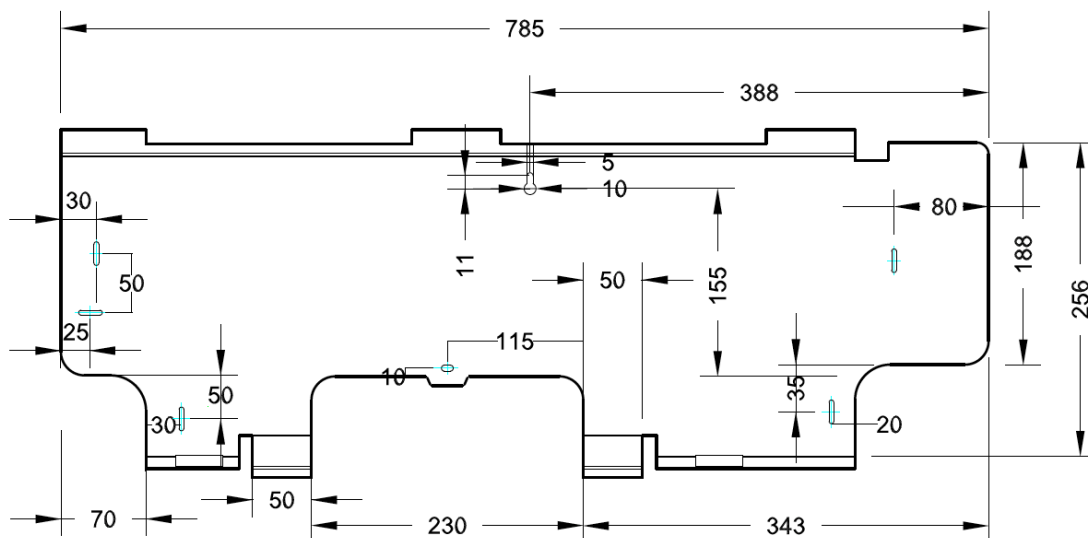


SWC-20/24/30 –ECM

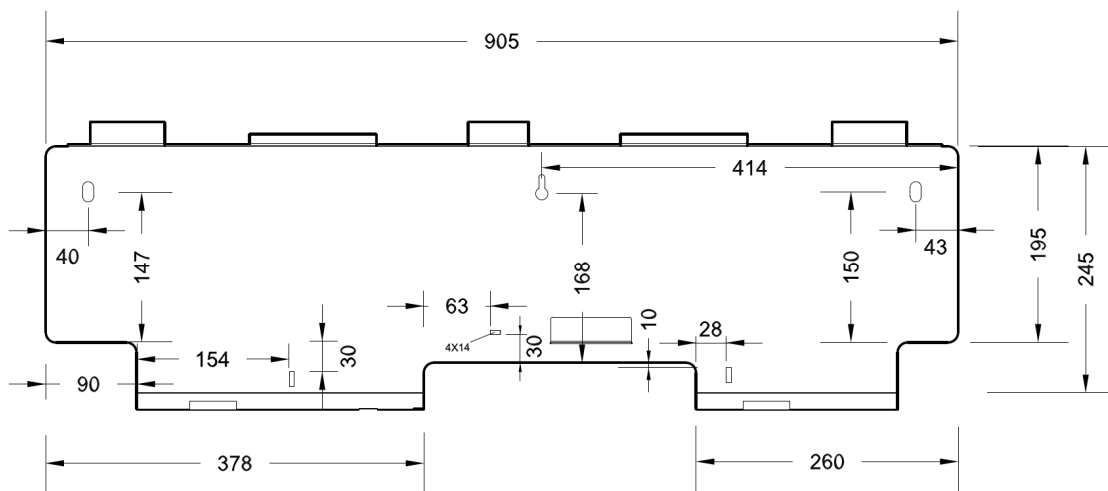


(All dimensions shown in mm)

B.4. Mounting Plate Installation

1. Select the structural position (e.g. a pillar or lintel) on the wall.
2. Then temporarily fasten the mounting plate on the wall with a steel nail.

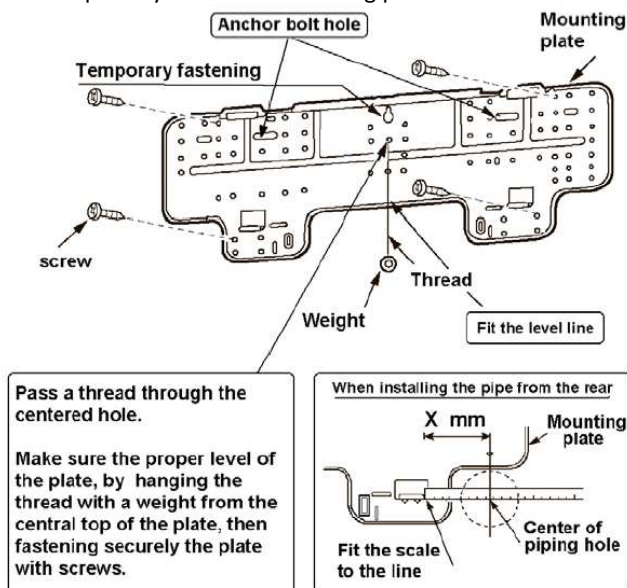

3. Mount the mounting plate horizontally as shown in the above figure or by means of gradiometer. Failed to follow this may cause water to drip indoors and create atypical noise.
4. Fix the mounting plate by means of expansion screws or tapping screws.



Drill a hole on the wall




Anchor plastic clip



Expansion screw


B.5. Condensate Drainage Hole Drilling

1. Ensure that the hole for condensate drainage is correctly positioned. The height should be lower than the bottom edge of the indoor unit.
2. Drill a 65mm diameter hole with a descending slope.
3. Seal it off with putty after installation.

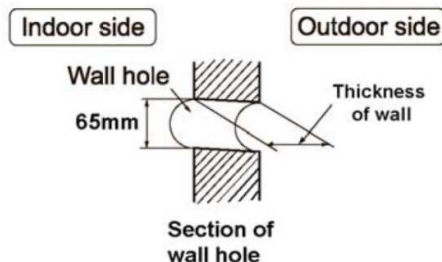


B.6. Hydronic Unit Installation

1. Pass the piping through the hole in the wall and hook the indoor unit on the mounting plate by the upper hooks.
2. Move the body of the unit from side to side to verify if it is securely fixed.
3. While pushing the unit toward the wall, lift it slightly from beneath to hook it up on the mounting plate by the lower hooks.
4. Make sure the unit firmly rests on the hooks of the mounting plate.

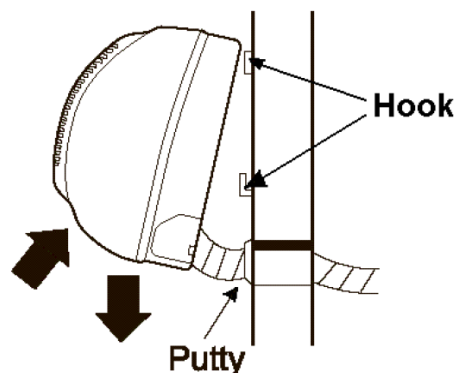


B.7. Drainage Piping Works

1. Install the drain hose so that it slopes downward slightly for free drainage. Avoid installing it as shown in the below illustrations marked with an "X".

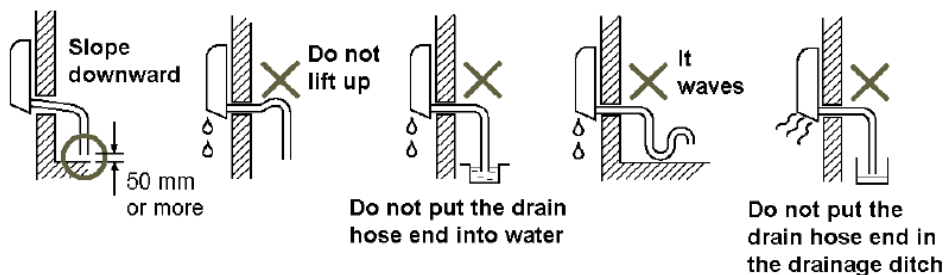


2. Put water in the drain pan and make sure that the water drains outdoors.
3. If the flexible drain hose provided with the indoor unit is not long enough, please extend it by joining it to an extension hose (not provided). Be sure to insulate the connecting part of the extension drain hose with a shield pipe as shown.

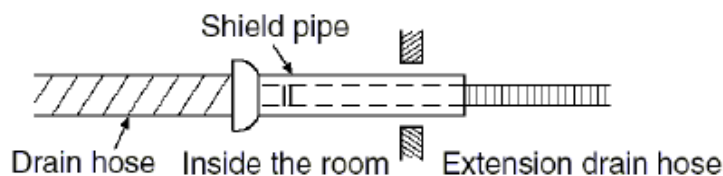


4. If the attached drain hose passes through an indoor area, insulate it with heat insulation material.

B.8. Pipe Connections with Valve

Pre-assembly

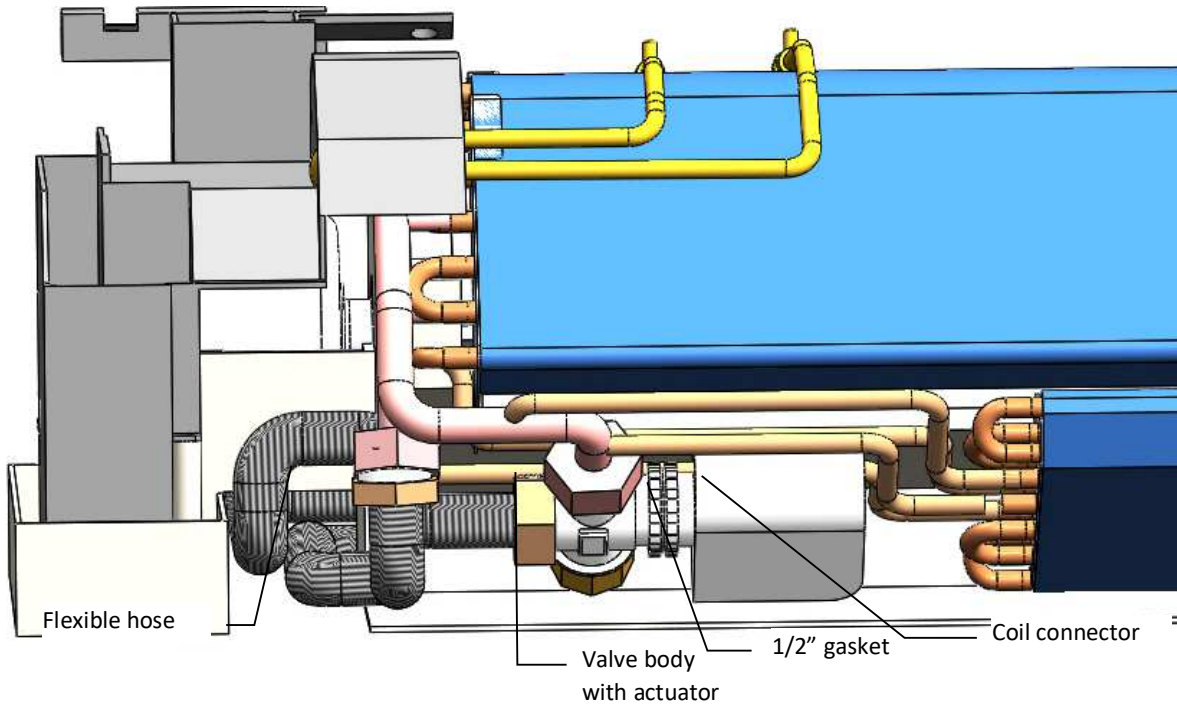

Complete Assembly

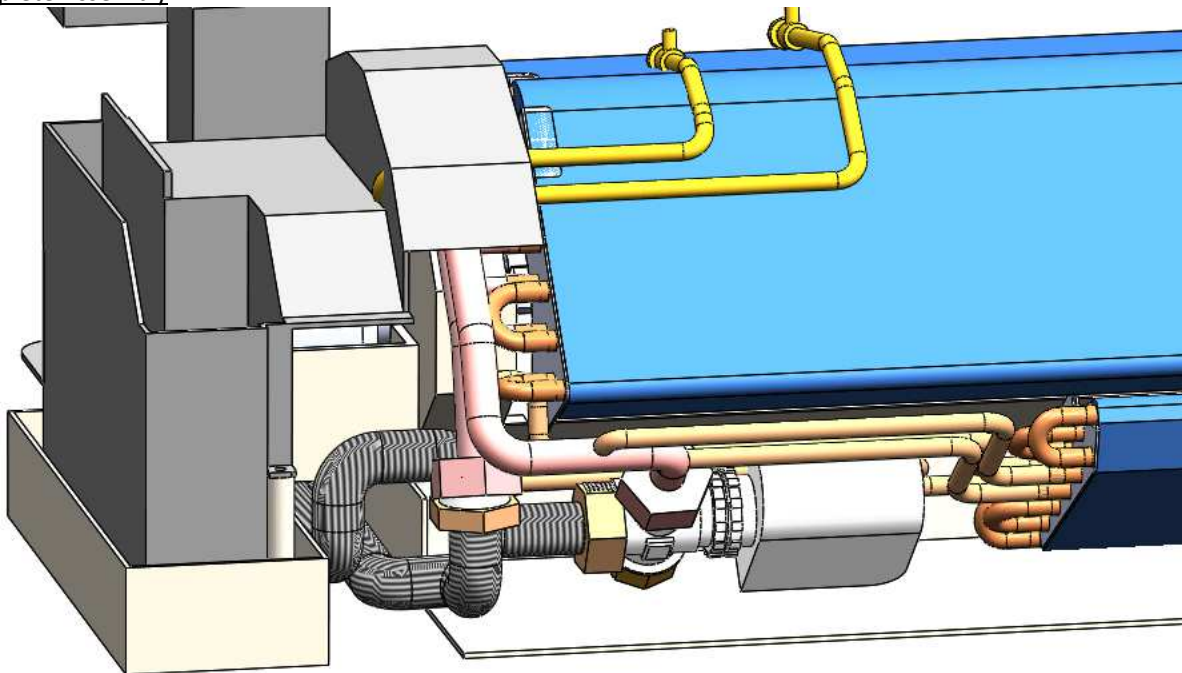

C. Maintenance

C.1. Opening and Closing of Lift-Up Grille Cover



Open the grille cover by lifting from the bottom position indicated by the arrows.



Close the grille cover by pressing down at the positions indicated by the arrows.

C.2. Front Cover Assembly Removal

1. Set the horizontal louver to the horizontal position.
2. Remove the screw caps below the louver, and then remove the mounting screws.
3. Open the lift-up grille cover by grasping the panel at both sides as shown above.
4. Remove the remaining screws located in the center of the front cover.
5. Grasp the lower part of the front cover and pull the entire assembly out and up towards you.

C.3. Air Vent and Water Purge Valves

1. After connecting the water inlet and outlet pipes to the main supply lines turn on the main breaker and operate the unit in COOLING mode.
2. Open the water inlet valve and flood the coil.
3. Check all connections for water leakage. If no leak is found, open the purging valve with an open end wrench while supporting the unit with your other hand. Then purge the air trapped inside the coil. When performing this activity, take care not to touch the electrical parts.
4. Close the purging valve when no bubbles appear.
5. Open the water outlet valve.

C.4. Wiring Connections

Unit components are wired to the terminal block of the indoor unit. Wiring can be accessed from the terminal block inside the control box.


D. Control Specifications: Intelligent Control (I TYPE)

D.1. I/O Port Definitions

I/O		Code	Description
Analogue Input	Return air Sensor	AI1	Return air temperature (Tr)
	Chilled water Sensor	AI2	Water inlet temperature sensor (Ti1)
	Hot water Sensor	AI3	Water outlet temperature sensor (Ti2)
Input	IR receiver	X-DIS 1	Digital communication port to LED display/IR receiver board.
	Wired wall pad	TTL1	Digital communication port to wired wall-pad board.
Digital input	Occupancy contact	ON/OFF	NO/NC contact by setting
	Float switch	Float	Voltage-free (NC). The contact is connected with float switch (NC).
	Electrical heater safety switch	EH	Voltage-free (NC). The contact is connected with E-heater safeties.
Power input	Phase	L	Power supply to the PCB.
	Neutral	N	Power supply to the PCB.
	Earth	G	Power supply to the PCB.
Voltage output	Fan 1	CN4	Fan 1 driver
	Valve1	MTV1	On/off valve
	Valve2	MTV2	On/off valve
	Water pump	WP	Voltage output (L), Power supply to condensate pump.
	Electrical heater	Heat	Voltage output (L), maximum 10A.
Output	Stepping motor	CN1, CN2	Power supply to louver stepping motors.
	Cooling free contact.	AUX1	Voltage free contact. Maximum load 5A.
	Heating r free contact.	AUX	Voltage free contact. Maximum load 5A.
	Modulating valve control	DA1	0~10VDC
	Modulating valve control	DA2	0~10VDC
	In Modbus signal	AB	Terminals for local network serial connection
	Out Modbus signal	AB	

D.2. Wiring Diagrams

iSWC-EC-S Wiring Diagram

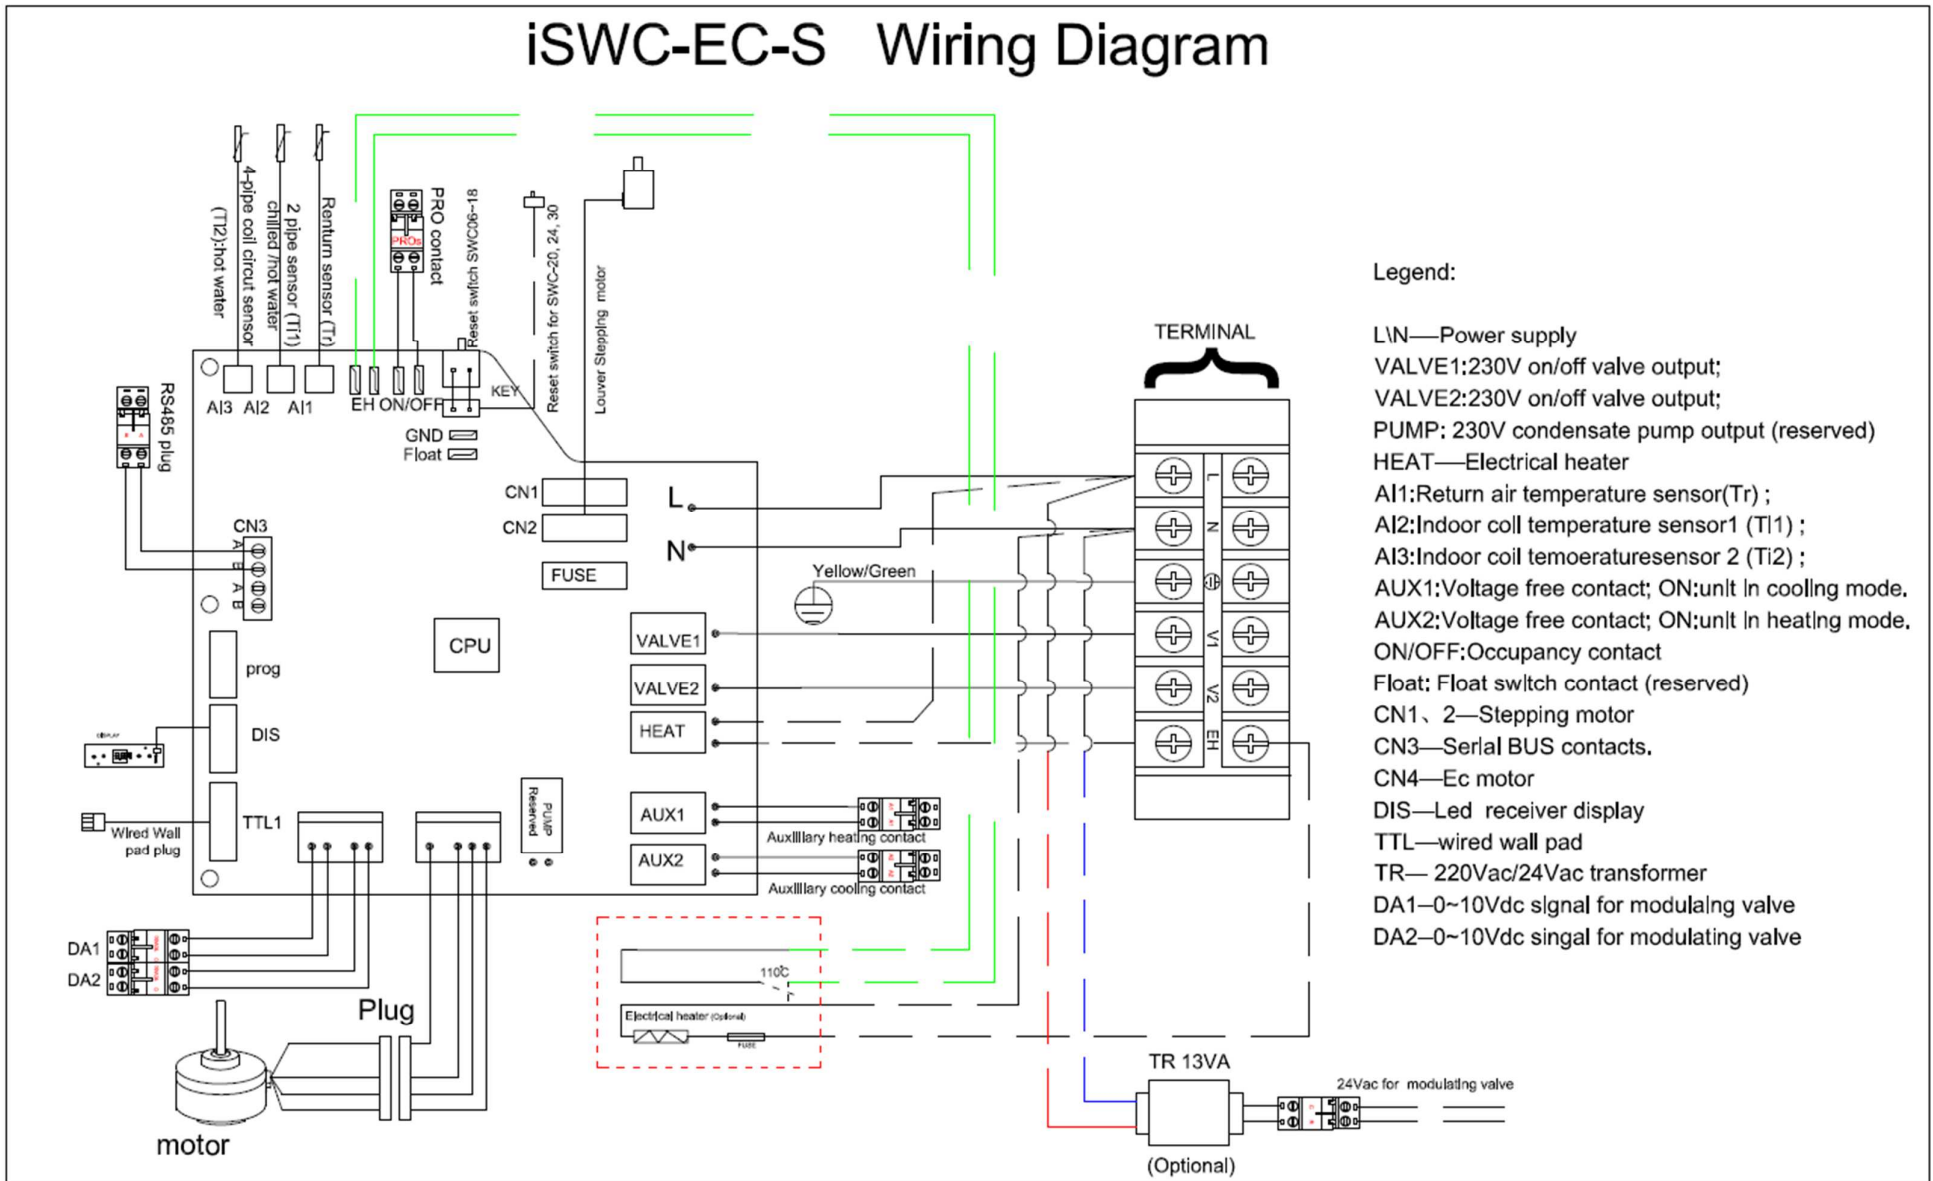

Legend:

- L/N—Power supply
- VALVE1:230V on/off valve output;
- VALVE2:230V on/off valve output;
- PUMP: 230V condensate pump output (reserved)
- HEAT—Electrical heater
- AI1:Return air temperature sensor (Tr) ;
- AI2:Indoor coil temperature sensor1 (Ti1) ;
- AI3:Indoor coil temperature sensor 2 (Ti2) ;
- AUX1:Voltage free contact; ON:unit in cooling mode.
- AUX2:Voltage free contact; ON:unit in heating mode.
- ON/OFF:Occupancy contact
- Float: Float switch contact (reserved)
- CN1、 2—Stepping motor
- CN3—Serial BUS contacts.
- CN4—Ec motor
- DIS—Led receiver display
- TTL—wired wall pad
- TR— 220Vac/24Vac transformer
- DA1—0~10Vdc signal for modulating valve
- DA2—0~10Vdc signal for modulating valve

D.3. Control Logics For 2-Pipe System

D.3.1. With Modulating Valve Configuration

COOL MODE

When unit is turned on in cooling mode.

If $T_r \geq T_s + 1^\circ\text{C}$ (Modbus 300033 setting), MTV1 is turned on. AUX1 is closed. Fan is turned on at setting speed. DA2 is turned on at 10 VDC for 2 minutes, then check Ti1:

- When $T_{i1} \leq 8^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting PID calculation. The output is minimum output (Modbus300015 setting) ~ 10 VDC.
- When $8 < T_{i1} \leq 10^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting minus 1 PID calculation. The output is minimum output (Modbus300015 setting) ~ 10 VDC.
- When $10 < T_{i1} \leq 12^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting minus 2 PID calculation. The output is minimum output (Modbus300015 setting) ~ 10 VDC.
- When $12 < T_{i1} \leq 15^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting minus 3 PID calculation. The output is minimum output (Modbus300015 setting) ~ 10 VDC.
- When $15 < T_{i1} \leq 28^\circ\text{C}$ (Modbus 300017 setting), DA2 output is kept at 10 VDC.
- When $T_{i1} > 28^\circ\text{C}$ (Modbus 300017 setting), DA2 output is at minimum (Modbus300016 setting).and report pre-heat alarm.
- If $T_r < T_s - 1^\circ\text{C}$ (Modbus 300033 setting), then cool operation is terminated and MTV1 and AUX1 are turned off. Indoor fan runs at set speed. DA2 output is 0 VDC.
- When unit is turned off, MTV1 and AUX1 are off. DA2 is 0 VDC. Fan is turned off delaying 30s.
- The range of T_s is 16 - 30°C
- Indoor fan speed can be adjusted to low, medium, high and auto.

LOW TEMPERATURE PROTECTION OF INDOOR COIL IN COOLING MODE

If $T_{i1} \leq 2^\circ\text{C}$ for 2 minutes

- MTV1 is turned OFF.
- DA2 is set to 0%.
- Indoor fan is turned on to Medium speed if fan runs at low speed.

If $T_{i1} \geq 5^\circ\text{C}$ for 2 minutes

- MTV1 is turned ON.
- DA2 is set to original status.
- Indoor fan is changed to setting speed.

FAN MODE

Indoor fan speed can be adjusted for low, medium and high. If fan speed is set auto by Modbus, fan is running at low speed.

HEAT MODE

Without Electrical Heater (Modbus300047=0)

When unit is turned on in heating mode.

When $T_r \leq T_s - 1^\circ\text{C}$ (Modbus 300033 setting), MTV1 and AUX2 is turned on. DA2 is at 10 VDC for 2 minutes, then check Ti1:

- If $T_{i1} < 28^\circ\text{C}$ (Modbus 300017 setting), fan is turned on at low speed. DA2 is at 10 VDC.
- If $28^\circ\text{C} < T_{i1} < 28$ (Modbus 3000017 setting) $+4^\circ\text{C}$, fan is on at original state. DA2 is at original state.
- If $T_{i1} \geq 28$ (Modbus 3000017 setting) $+4^\circ\text{C}$, fan is on at setting speed. DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting PID calculation. The output is minimum output (Modbus300015 setting) ~ 10 VDC.
- If Ti1 sensor is damaged, fan runs at setting speed.

- When $Tr > Ts + 1^{\circ}\text{C}$ (Modbus 300033 setting), MTV1 and AUX2 is turned off. DA2 is at 0 VDC. fan is turned on at lowest speed.
- When unit is turned off, MTV1 and AUX2 is turned off. DA2 is at 0 VDC. Fan is turned off delaying 2 minutes.

With Electrical Heater as booster (Modbus300047=1)

When unit is turned on in heating mode.

When $Tr \leq Ts - 1^{\circ}\text{C}$ (Modbus 300033 setting), MTV1 and AUX2 is turned on. Fan is turned on at setting speed. DA2 is at 10 VDC for 2 minutes, then check Ti1:

- If $Ti1 < 28^{\circ}\text{C}$ (Modbus 300017 setting), EH is turned on. DA2 is at 10 VDC.
- If $28^{\circ}\text{C} < Ti1 < 28$ (Modbus 300017 setting) $+4^{\circ}\text{C}$, EH is kept at original state. DA2 is at original state.
- If $Ti1 \geq 28$ (Modbus 300017 setting) $+4^{\circ}\text{C}$, EH is turned off. DA2 output is based on water temperature difference ($Ti1/Ti2$) and Modbus parameter 300027 setting PID calculation. The output is minimum output (Modbus300015 setting) ~ 10 VDC.
- If Ti1 sensor is damaged, fan runs at setting speed.
- When $Tr > Ts + 1^{\circ}\text{C}$ (Modbus 300033 setting), MTV1 and AUX2 is turned off. EH is turned off. DA2 is at 0 VDC. Fan is turned on at low speed.
- When unit is turned off, MTV1 and AUX2 is turned off. DA2 is at 0 VDC. Fan is turned off delaying 2 minutes.

With Electrical Heater as booster (Modbus300047=2)

When unit is turned on in heating mode.

- When $Ti2 \leq 35^{\circ}\text{C}$ (or $Ti2$ is broken) and $Tr \leq Ts - 1^{\circ}\text{C}$ (Modbus 300033 setting), fan is turned on at setting speed, EH is turned on.
- When $Tr > Ts$ $^{\circ}\text{C}$, EH is turned off. Fan is turned on at low speed.
- When unit is turned off, EH is turned off. Fan is turned off delaying 2 minutes.

OVER-HEAT PROTECTION OF INDOOR COIL

- If $Ti1 \geq 75^{\circ}\text{C}$, then MTV1, AUX2, DA2 and EH are turned off. Indoor fan remains on and runs at high speed.
- If $Ti1 < 70^{\circ}\text{C}$, then unit keep original state.
- If the indoor coil temperature sensor is damaged or not connected, then the protection mode will be overridden, and the unit will work according to the pre-heat and post-heat program.

DEHUMIDIFICATION MODE

When unit is turned on in dehumidification mode:

- AUX1 is turned on. Ts is 24°C .
- If $Tr \geq 25^{\circ}\text{C}$ for 30S, then MTV1 will be ON for 3 minutes, and then OFF for 4 minutes. DA2 is on at 3 times of (Modbus 300016 setting). Fan is turned on at low speed.
- If $16^{\circ}\text{C} \leq Tr < 25^{\circ}\text{C}$ for 30S, then MTV1 will be ON for 3 minutes, and then OFF for 6 minutes. DA2 is on at double of (Modbus 300016 setting). Fan is turned on at low speed.
- If $Tr < 16^{\circ}\text{C}$ for 30S, then MTV1 will be ON for 3 minutes, and then OFF for 10 minutes. DA2 is on at (Modbus 300016 setting). Fan is turned on at low speed.
- At the end of the above dehumidification cycle, the system will decide the next dehumidification control option.

AUTO MODE

When unit is turned on in Auto mode, fan is turned on at setting speed for 30S, then check Tr and Ts .

- If $Ts \geq Tr + 3^{\circ}\text{C}$, the unit is worked in heating mode.
- If $Tr - 3^{\circ}\text{C} < Ts < Tr + 3^{\circ}\text{C}$, the unit is worked in fan mode.
- If $Ts < Tr - 3^{\circ}\text{C}$, the unit runs in cooling mode.
- If unit working mode is confirmed, the unit will not change the working mode. After the unit is turned off and restart it in 2 hours, working mode will be confirmed again.

PRO INPUT FUNCTION

When 100004=0:

The unit is on.

- PRO input is closed for 60S, the unit is turned off.
- PRO input is open for 60S, the unit is turned on.

When 100004=1.

- The unit is on or standby, PRO input is open or closed, the unit is kept original state.
- The unit is off,
- PRO input is closed for 30S, MTV1 is turned on, DA2 is open at double of minimum setting (Modbus 300027 setting). Fan runs at low speed.
- PRO input is opened for 30S, MTV1 is off, DA2 is 0Vdv, fan is turn off.
- In period of PRO closed time, if unit receives instruction from remote handset, wired wall pad or Modbus, the unit will work according to the instruction at once.

D.3.2. 2-pipe Control Logic -With 6-way modulating Valve Configuration

COOL MODE

When unit is turned on in cooling mode:

- If $T_r \geq T_s + 1^\circ\text{C}$ (Modbus 300033 setting), MTV1 is turned on. AUX1 is closed. Fan is turned on at setting speed.
- DA2 is turned on at 0VDC for 2 minutes, then check Ti1,
- When $T_{i1} \leq 8^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting PID calculation. The output is 4~0VDC.
- When $8 < T_{i1} \leq 10^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting minus 1 PID calculation. The output is 4~0VDC.
- When $10 < T_{i1} \leq 12^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting minus 2 PID calculation. The output is 4~0VDC.
- When $12 < T_{i1} \leq 15^\circ\text{C}$, DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300027 setting minus 3 PID calculation. The output is 4~0VDC.
- When $15 < T_{i1} \leq 28^\circ\text{C}$ (Modbus 300017 setting), DA2 output is kept at 0VDC.
- When $T_{i1} > 28^\circ\text{C}$ (Modbus 300017 setting), DA2 output is 4VDC. and report pre-heat alarm.
- If $T_r < T_s - 1^\circ\text{C}$ (Modbus 300033 setting), then cool operation is terminated and MTV1 and AUX1 are turned off. Indoor fan runs at set speed. DA2 output is 5VDC.
- When unit is turned off, MTV1 and AUX1 are off. DA2 is 5VDC. Fan is turned off delaying 30s.

LOW TEMPERATURE PROTECTION OF INDOOR COIL IN COOLING MODE

If $T_{i1} \leq 2^\circ\text{C}$ for 2 minutes:

- MTV1 is turned OFF.
- DA2 is set to 5 VDC.
- Indoor fan is turned on to Medium speed if fan runs at low speed.

If $T_{i1} \geq 5^\circ\text{C}$ for 2 minutes:

- MTV1 is turned ON.
- DA2 is set to original status.
- Indoor fan is changed to setting speed.

FAN MODE

Indoor fan speed can be adjusted for low, medium and high. If fan speed is set auto by Modbus, fan is running at low speed.

HEAT MODE

Without Electrical Heater (Modbus300047=0)

When unit is turned on in heating mode:

- When $T_r \leq T_s - 1^\circ\text{C}$ (Modbus 300033 setting), MTV2 and AUX2 is turned on. DA2 is at 10VDC for 2 minutes, then check Ti1:
- If $T_{i1} < 28^\circ\text{C}$ (Modbus 300017 setting), fan is turned on at low speed. DA2 is at 10VDC.
- If $28^\circ\text{C} < T_{i1} < 28$ (Modbus 300017 setting) $+4^\circ\text{C}$, fan is on at original state. DA2 is at original state.
- If $T_{i1} \geq 28$ (Modbus 300017 setting) $+4^\circ\text{C}$, fan is on at setting speed. DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300028 setting PID calculation. The output is 6~10VDC.
- If Ti1 sensor is damaged, fan runs at setting speed.
- When $T_r > T_s + 1^\circ\text{C}$ (Modbus 300033 setting), MTV1 and AUX2 is turned off. DA3 is at 5VDC. Fan is turned on at lowest speed.
- When unit is turned off, MTV1 and AUX2 is turned off. DA2 is at 5VDC. Fan is turned off delaying 2 minutes.

With Electrical Heater as booster (Modbus300047=1)

When unit is turned on in heating mode:

- When $T_r \leq T_s - 1^\circ\text{C}$ (Modbus 300033 setting), MTV2 and AUX2 is turned on. Fan is turned on at setting speed. DA2 is at 10VDC for 2 minutes, then check Ti1:
- If $T_{i1} < 28^\circ\text{C}$ (Modbus 300017 setting), EH is turned on. DA2 is at 10 VDC.
- If $28^\circ\text{C} < T_{i1} < 28$ (Modbus 300017 setting) $+4^\circ\text{C}$, EH is kept at original state. DA2 is at original state.
- If $T_{i1} \geq 28$ (Modbus 300017 setting) $+4^\circ\text{C}$, EH is turned off. DA2 output is based on water temperature difference (T_{i1}/T_{i2}) and Modbus parameter 300028 setting PID calculation. The output is 6~10 VDC.

- If Ti1 sensor is damaged, fan runs at setting speed.
- When $T_r > T_s + 1^\circ\text{C}$ (Modbus 300033 setting), MTV2 and AUX2 is turned off. EH is turned off. DA2 is at 5VDC. fan is turned on at low speed.
- When unit is turned off, MTV2 and AUX2 is turned off. DA2 is at 5 VDC. Fan is turned off delaying 2 minutes.

OVER-HEAT PROTECTION OF INDOOR COIL

- If $T_{i1} \geq 75^\circ\text{C}$, then MTV1, AUX2, DA2 and EH are turned off. Indoor fan remains on and runs at high speed.
- If $T_{i1} < 70^\circ\text{C}$, then unit keep original state.
- If the indoor coil temperature sensor is damaged or not connected, then the protection mode will be overridden and the unit will work according to the pre-heat and post-heat program.

DEHUMIDIFICATION MODE

When unit is turned on in dehumidification mode:

- AUX1 is turned on. T_s is 24°C .
- If $T_r \geq 25^\circ\text{C}$ for 30S, then MTV1 will be ON for 3 minutes, and then OFF for 4 minutes. DA2 is 2VDC. Fan is turned on at low speed.
- If $16^\circ\text{C} \leq T_r < 25^\circ\text{C}$ for 30S, then MTV1 will be ON for 3 minutes, and then OFF for 6 minutes. DA2 is 2.5VDC. Fan is turned on at low speed.
- If $T_r < 16^\circ\text{C}$ for 30S, then MTV1 will be ON for 3 minutes, and then OFF for 10 minutes. DA2 is 3.5VDC.
- At the end of the above dehumidification cycle, the system will decide the next dehumidification control option.

AUTO MODE

When unit is turned on in Auto mode, fan is turned on at setting speed for 30S, then check T_r and T_s :

- If $T_s \geq T_r + 3^\circ\text{C}$, the unit runs in heating mode.
- If $T_r - 3^\circ\text{C} < T_s < T_r + 3^\circ\text{C}$, the unit runs in fan mode.
- If $T_s < T_r - 3^\circ\text{C}$, the unit runs in cooling mode.
- If unit works in heating or fan mode, when $T_r - T_s > 3.0^\circ\text{C}$, MTV2, MTV1 and DA2 is off for more than 10minutes. EH is off for more than 10 minutes, the unit will work in cooling mode.
- If unit works in cooling or fan mode, when $T_s - T_r > 3.0^\circ\text{C}$, MTV2, MTV1 and DA2 is off for more than 10minutes. The unit will work in heating mode.

PRO INPUT FUNCTION

The unit is on:

- PRO input is closed for 60S, the unit is turned off.
- PRO input is open for 60S, the unit is turned on.

D.4. Sleep Mode

- SLEEP mode can only be set when the unit is in COOL or HEAT mode.
- In COOL mode, after SLEEP mode is set, the indoor fan will run at auto speed and Ts will increase by 0.5°C each 30minutes. Maximum setting temperature increased is 3°C.
- In HEAT mode, after SLEEP mode is set, the indoor fan will run at auto speed and Ts will decrease by 0.5 °C each 30 minutes.
- Sleep mode is turned off, setting temperature go back and Fan is changed to setting speed.

D.5. Louver

For remote handset

Whenever the indoor fan is running, the louver can swing or stop at the desired position.

Louver angle: 0°~100°, opens clockwise with widest angle at 100°.

Swing angle: 35°~100°, opens clockwise to 68°. Below are the 4 fixed positions which can be set from wireless LCD handset.

Position	Angle
1	35°
2	57°
3	83°
4	100°

For wired wall pad

Louver angle: 0°~100°, opens clockwise, with widest angle at 100°.

Swing angle: 35°~100°, opens clockwise to 68°. User may stop louver at any desired position between 35°~100°.

D.6. Buzzer

The unit will beep once when it receives a signal.

D.7. Auto Restart

The system uses non-volatile memory to save the present operation parameters when system is turned off or in case of system failure or cessation of power supply. When power supply resumes or the system is switched on again, the same operations as previously set will function.

D.8. On/Off Switch

- This is a tact switch to select COOL → HEAT → OFF operation mode.
- In COOL mode, the set temperature of the system is 24°C with auto fan speed. There are no timer and SLEEP modes.
- In HEAT mode, the set temperature of the system is 24°C with auto fan speed. There are no timer and SLEEP modes.
- Master unit that does not use a LCD wall pad will globally broadcast.

Note: When button pressing is effective, the master unit buzzer will beep twice and the slave unit will beep once.

D.9. Drain Pump

Drain pump turns on if thermostat cut in during cooling or dehumidification cooling cycle. It will remain on for at least 5 minutes after thermostat cut out. During mode change from cooling to non-cooling mode, water pump will on for minimum 5 minutes.

D.10. Float Switch

Float switch open before turning on.

If float switch (N/C) is opened before the unit is turned on, If in Cool Mode MV1Da2 will be off/0%. Drain pump and indoor fan will operate. After float switch is closed, MTV1/COOL is on.

Float switch is opened, when unit is on.

If float switch is opened continuously ≥ 5 sec, drain pump will work and If in Cool Mode MV1 will be off/0%. When the float switch is closed, the drain pump will run for additional 5 minutes. If the float switch is opened for 10 minutes continuously, MV1 will remain off. Indoor fan runs at set speed and system report error.

Float switch is opened, when unit is off.

If the float switch is opened, the drain pump will work. When the float switch is closed, the drain pump will run for additional 5 minutes. If the float switch is opened for 10 minutes continuously, system report error.

D.11. Electric Heater Safety Switch

Before the electrical heater is turned on, the EH safety switch must be closed, EH is open for 3 minutes and EC motor RPM must be more than MODBUS300020 setting

When electrical heater is ON, electrical heater safety switch is opened for ≥ 1 second or EC motor RPM is lower than Modbus 300020 setting, EH will be turned off immediately and report an error and fan speed is changed to high speed.

Once the contact is returned to the closed ≥ 180 seconds and EC motor RPM must be more than MODBUS300020 setting, reset the error and the heater will start again.

When the EH safety switch is opened ≥ 3 times within 60 minutes the heater is not allowed to start anymore.

Turn off the unit to reset the fault, provided that the switch has returned to the closed position.

D.12. Low Temperature Protection of Indoor Coil in Winter

This is frost protection for when the unit is off to prevent water in the coil and room from freezing.

If 2-pipe unit is in Standby Mode

If $Tr \leq 2$ °C for 2 minutes

- MTV1 is turned ON.
- AUX2 is closed.
- DA2 is 5 VDC.
- If $Ti1 < 5$ °C for 2 minutes EH (if present) is switched on.
- Indoor fan is turned on at low speed.

If $Tr \geq 5$ °C for 2 minutes

- MTV2 is off.
- AUX2 is open.
- DA2 is set to 0 VDC.
- Electric Heater is turned off.
- Indoor fan is switched off.

If 4-pipe unit is in Standby Mode

If $Tr \leq 2$ °C for 2 minutes

- MTV2 is turned ON.
- AUX2 is closed.
- DA3 is 5VDC. If unit with 6-way valve, DA2 is 8 VDC.
- If $Ti1 < 5$ °C for 2 minutes EH (if present) is switched on.
- Indoor fan is turned on at low speed.

If $Tr \geq 5$ °C for 2 minutes

- MTV2 is OFF.
- AUX2 is open.
- DA3 is set to 0. If unit with 6-way valve, DA2 is 5 VDC.
- Electric Heater is turned off.
- Indoor fan is switched off.

D.13. Network Setup

1. Disconnect the communication plug from the control box




2. Communication plug


A, B, A, B is printed on the main PCB. When you connect the wires, please ensure connection of A to A and B to B.



3. Connection wire


- i. If the total length of wire is more than 1000 m, please use shielded wire in order to protect the signal transmission.
- ii. Complete wire connection

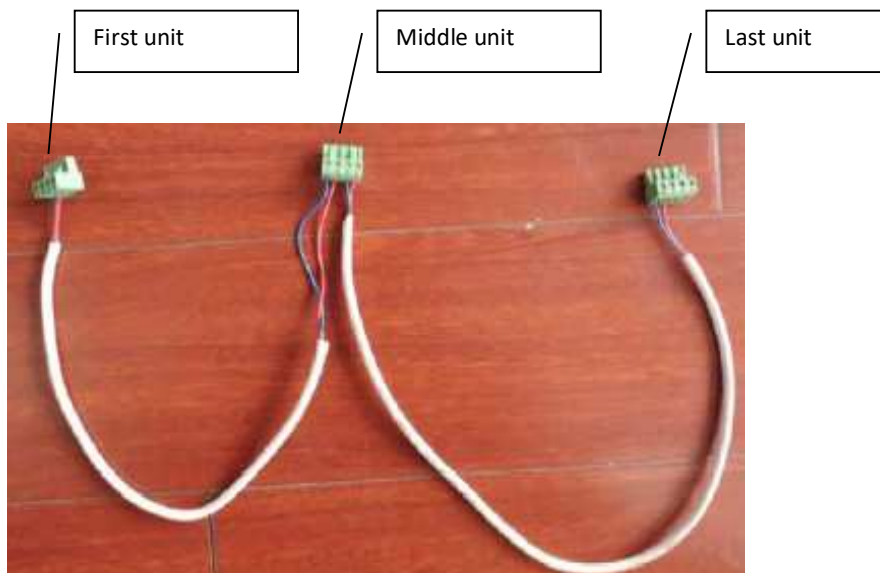

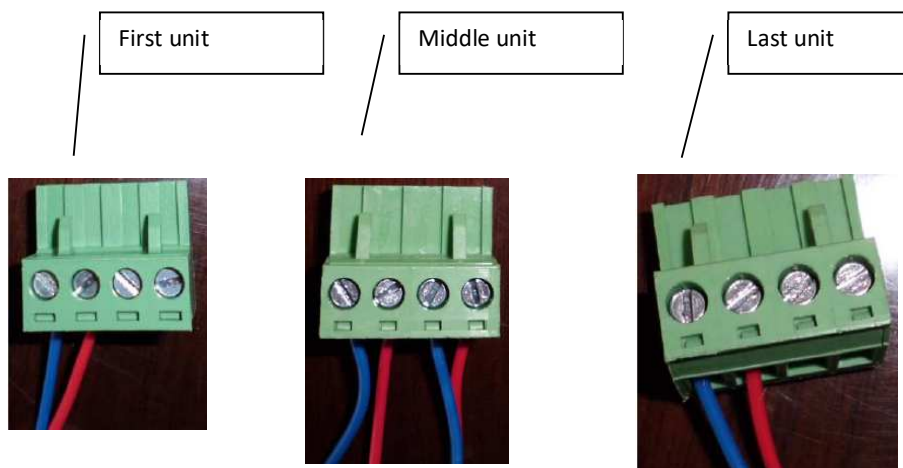

iii. Wire connection check

- 1) After the wire connection is completed, please check that the wire colours correspond.
- 2) Check the wire contact by using a multimeter.

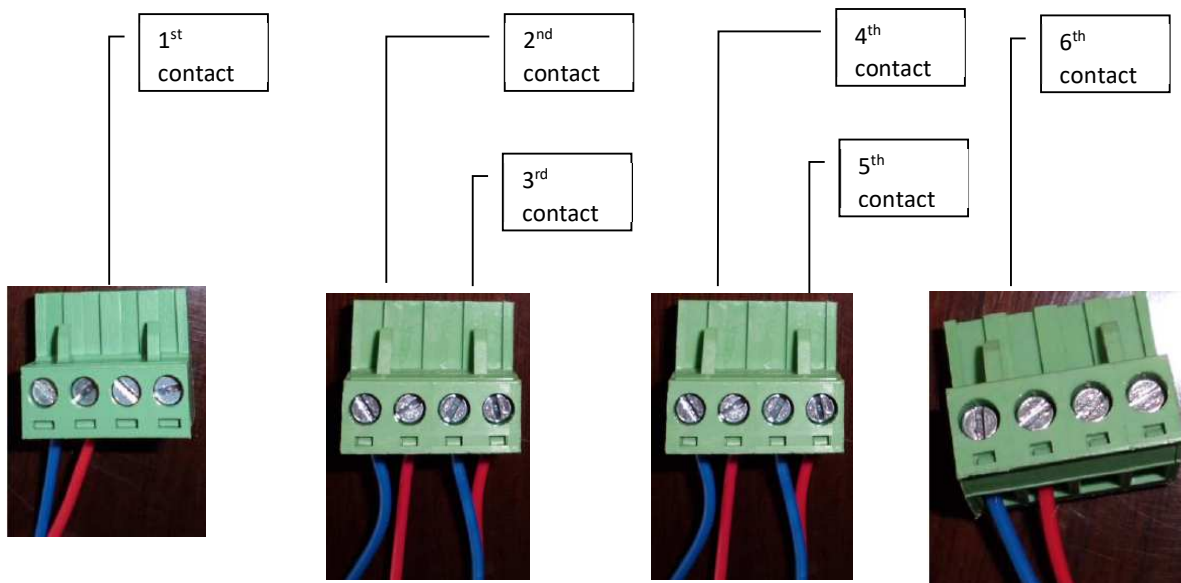

- 3) Check 1 and 2, 3 and 4, 5 and 6 to be sure the connections are correct.
- 4) If the resistance between two wire contacts is too high, please check and reconnect the wire contacts.

4. Reconnect the communication plug to the control box

D.14. Open Modbus Protocol

Transfer Mode: RTU BAUD Rate: 9600bps, 8 data bit, 1 stop bit, None parity bit

The communications require a delay between reading an answer and sending the next command of 80 ms.. All temperature is equal to reading data*10 accuracy: 0.1 degree C.

Supported Functions

Function Code	Function description
01(01H)	Read Coils
02(02H)	Read Discrete Inputs
03(03H)	Read Holding Registers
04(04H)	Read Input Registers
05(05H)	Write Single Coil
06(06H)	Write Single Register
15(0FH)	Write Multiple Coils
16(10H)	Write Multiple Registers
255(FFH)	Extended Commands which are used to test.

Valid Error code table:

Error code	description	definition
01 (01H)	Invalid commands	Received commands beyond valid commands
02 (02H)	Invalid data address	Data addresses beyond valid data address
03 (03H)	Invalid data	Data beyond definition range
04 (04H)	Write data not succeed	Write data not succeed

Coils table:

Description	Address	Type*	Remark
ON/OFF	100000	R/W	
Sleeping mode	100001	R/W	
Louver swings	100002	R/W	
Energy Saving Mode	100003	R/W	
PRO function	100004	R/W	

Discrete table:

Description	Address	Type*	Remark
MTV1	200000	R	
MTV2	200001	R	
AUX1	200002	R	
AUX2	200003	R	
Condensate pump	200004	R	
Electrical heater	200005	R	
Wired wall pad	200006	R	
PR-O1	200007	R	
Float switch	200008	R	
Reserved	200009	R	
EH safety switch	200010	R	
Internal test	200011	R	Testing purpose only.

* R = read only, W = write only, R/W = read and write.

Holding Register table:

Description	Address	Type*	Remark
Mode setting	300000	R/W	Cooling mode = 01(H) Humidify mode = 02(H) Fan mode = 04(H) Heating mode = 08(H) Auto mode = 10(H)
Fan speed setting	300001	R/W	Low speed = 04(H) Medium speed = 02(H) High speed = 01(H) Auto fan speed = 07(H)
Louver swing setting	300002	R/W	Position 1=01(H)
			Position2=02(H)
			Position3=03(H)
			Position4=04(H)
			Auto=0F(H)
Stop=00(H)			
Setting temperature	300003	R/W	16~30 (actual*10 format)
Address setting	300004	R/W	1~255
Reset	300005	W	=0x33 reset error
Week	300006	W	
Hour	300007	W	
Minute	300008	W	
Second	300009	W	
Hours in Timer on	300010	R/W	Timer ON
Minute in Timer on	300011	R/W	Timer ON
Hours in Timer off	300012	R/W	Timer OFF
Minute in Timer off	300013	R/W	Timer OFF
Icon of Timer ON or OFF	300014	R/W	BIT0 = Icon of Timer ON BIT1 = Icon of Timer OFF 1 = enable 0 = disable
Minimum output DA1	300015	R/W	Default 25% (2.5VDC)
Minimum output DA2	300016	R/W	Default 25% (2.5VDC)
Pre-heat temperature setting	300017	R/W	25~35, default: 30
Reserved-	300018	R/W	
Super low speed rpm	300019	R/W	
Low speed rpm	300020	R/W	
Medium speed rpm	300021	R/W	
High speed rpm	300022	R/W	
Signal output setting	300023	R/W	1~10VDC (used to test, 0 = disable)
Temperature sampling time	300024	R/W	2~100, default: 5S
Factor of auto fan speed	300025	R/W	2~150, default: 20
Factor of modulating valve	300026	R/W	2~250, default: 150
Ti1 and Ti2 Cooling difference setting	300027	R/W	3~15, default: 5
Ti1 and Ti2 Heating difference setting	300028	R/W	3~15 default: 5
Controller Hardware type setting	300029	R/W	0=air cleaner (S5) 1=FCU (S1/S2/S3, SWC-S) 2=AHU (S6) or (AHU+W5) 3=AHU+AQI (S5+S6) 4=Zone controller(S7) Setting: 1
Degree unit setting	300030	R/W	0=degree C 1=degree F
Temperature display setting	300031	R/W	0=Room temperature display on LED 1=Setting temperature display on LED


Setting temperature range	300032	R/W	0=setting temperature range is from 16~30 1=Setting temperature range is fixed. Cooling=24°C Heating=21°C
Temperature band setting	300033	R/W	
Reserved	300034	R/W	
Reserved	300035	R/W	
Reserved	300036	R/W	
Reserved	300037	R/W	
Reserved	300038	R/W	
Reserved	300039	R/W	
Reserved	300040	R/W	
Reserved	300041	R/W	
Reserved	300042	R/W	
Reserved	300043	W	
Reserved	300044	W	
Reserved	300045	W	
Software type	300046	R/W	0=2-pipe+MTV 1=2-pipe without valve 2=4-pipe+std valve 3=4-pipe+6-way valve
EH type	300047	R/W	0=without EH, 1=EH as booster. 2=EH as primary
DA1 control signal	300048	R/W	0=Tr/Ts 1=ESP
EC motor input ports	3000049	R/W	0=CN4 working. 1=CN5 working 2=CN4+CN5 working default: 0
PRO1 input type	300050	R/W	0=NO. 1=NC
Tr sensor setting	300051	R/W	0=sensor on the wired wall pad. 1=sensor on the main PCB. default: 0
Reserved	300052	R/W	0~120, default: 80
Optimized swing angle	300053	R/W	200~999 default: 0.
E-heater	300054	R/W	Unit: KW*10
Room temp. factor	300055	R/W	90~120, default: 103
Water inlet temp. factor	300056	R/W	90~120, default: 103
Delta T factor	300057	R/W	90~120, default: 102
Product type	300058	R/W	00~99. default: 00
Product model	300059	R/W	000~999. default: 000
Ex-works data	300060	R/W	0000—9999
Software version	300061	R	10~99 default: 10
Hardware version	300062	R	10~99 default: 10
Reserved	300063	R/W	
Reserved	300064	R/W	
Reserved	300065	R/W	
Reserved	300066	R/W	
Reserved	300067	R/W	
In auto mode, temp. band setting	300068	R/W	1~15, default: 3
Reserved	300069	R/W	
Reserved	300070	R/W	
Unit power input at High speed	300071	R/W	W*10
Unit power input at Med. speed	300072	R/W	W*10
Unit power input at Low speed	300073	R/W	W*10
Unit heat capacity at High speed	300074	R/W	KW*10
Unit heat capacity at Med. speed	300075	R/W	KW*10
Unit heat capacity at Low speed	300076	R/W	KW*10
Unit cool capacity at High speed	300077	R/W	KW*10
Unit cool capacity at Med. speed	300078	R/W	KW*10
Unit cool capacity at Low speed	300079	R/W	KW*10

* R = read only, W = write only, R/W = read and write.

Input Register table:

Description	Address	Type*	Remark
Tr temperature sensor	400000	R	
Ti1 temperature sensor	400001	R	
Ti2 temperature sensor	400002	R	
Reserved	400003	R	
Reserved	400004	R	
Error code	400005	R	Bit0 = Room temperature sensor error Bit1 = Ti1 temperature sensor error Bit2 = Ti2 temperature sensor error Bit3 = Float switch error Bit4 = Indoor coil low temperature protection Bit5 = Indoor coil overheat protection Bit6 = Filter switch Bit7 = Electrical heater failure Bit8 = Motor1 Error Bit9 = Motor2 Error Bit10 = System parameters error Bit11 = Anti-frozen error Bit12 = Ti3 temperature sensor error Bit13 = Ti4 temperature sensor error Bit14 = PM2.5 sensor Bit15 = AQI Error
Fan speed status	400006	R	Low = 04(H) Medium = 02(H) High = 01(H)
Reserved	400007	R	
Reserved	400008	R	
EH	400009	R	0= disable, 1=booster, 2=primary
Unit type	400010	R	
DA1	400011	R	
DA2	400012	R	
Reserved	400013	R	
Reserved	400014	R	
Reserved	400015	R	
Reserved	400016	R	
Unit status	400017	R	Cooling mode = 01(H) Humidify mode = 02(H) Fan mode = 04(H) Heating mode = 08(H) Unit OFF=32(H)
Temperature in wall pad	400018	R	
Motor running time	400019	R	
Motor running terms	400020	R	0~100
Cooling capacity	400021	R	
Cooling capacity terms	400022	R	0~100
Heating capacity	400023	R	
Heat capacity terms	400024	R	0~100
Reserved	400025	R	
Reserved	400026~35	R	
EC motor1 actual RPM	400036	R	
EC motor2 actual RPM	400037	R	
EC motor1 error	400038	R	
EC motor2 error	400039	R	

D.15. LED Display and Error Description

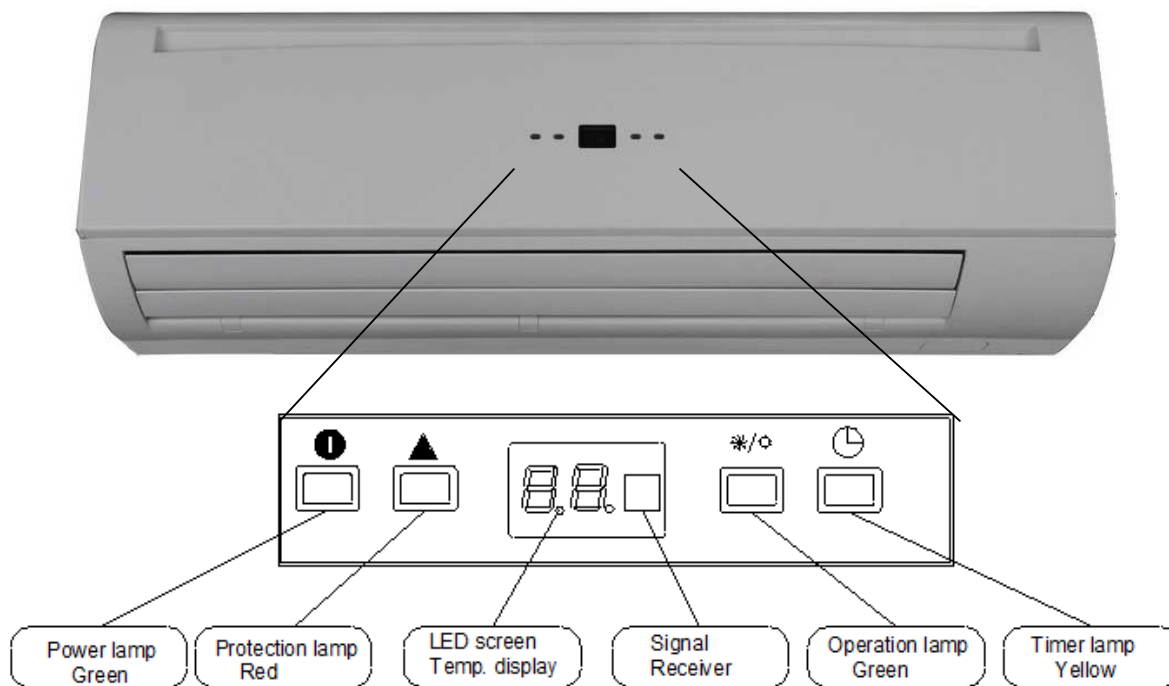

Power / Operation LED light (both green)	
Unit on	Power LED Off, Operation LED On
Unit in standby	Power LED On, Operation LED Off


Error Description	For all units - Green LED			
	Blink	LED display	Reason	Remedy
Return air sensor failure	Green LED blinks 1 times, stops for 3s	E1	Room sensor unplugged or damaged.	1. Check if Tr plug is connected or not. 2. Check if sensor's resistance is correct or not.
Indoor coil sensor 1 failure	Green LED blinks 2 times, stops for 3s	E2	Ti1 sensor unplugged or damaged.	1. Check if Ti1 plug is connected or not. 2. Check if sensor's resistance is correct or not.
Indoor coil sensor 2 failure	Green LED blinks 3 times, stops for 3s	E3	Ti2 sensor unplugged or damaged.	1. Check if Ti2 plug is connected or not. 2. Check if sensor's resistance is correct or not.
Water pump failure	Green LED blinks 4 times, stops for 3s	E4	Float switch is opened.	1. Check if the condensate water pipe is connected or not. 2. Check if the pump is functioning or not.
Indoor coil low temperature protection	Green LED blinks 5 times, stops for 3s	E5	Water temperature is lower than 3 °C.	Check the water temperature.
Indoor coil overheat protection	Green LED blinks 6 times, stops for 3s	E6	Water temperature is higher than 70 °C.	Check the water temperature
		E7		1. Check if filter block or not

Filter Switch (S6 PCB)	Green LED blinks 7 times, stops for 3s		Filter switch is opened.	2. replace the new filter
Electric Heater failure	Green LED blinks 8 times, stops for 3s	E8	<i>Only for unit with EH.</i>	1. Change fan speed to high.
			EH safety switch is opened.	2. Replace the damaged EH safety switch.
EC motor failure(CN4)	Green LED blinks 9 times, stops 3s	E9	No EC motor feedback	1. Check Modbus setting. 2. Check the EC motor.
EC motor failure(CN5)	Green LED blinks 10 times, stops 3s	E10	No EC motor feedback	1. Check Modbus setting. 2. Check the EC motor.
Anti-frozen protection	Green LED blinks 12 times, stops for 3s	E12	When unit is standby, Tr<2°C.	1. Turn on unit to keep Tr high than 5°C
Indoor coil sensor 3 failure (S6 PCB)	Green LED blinks 13 times, stops for 3s	E13	Ti3 sensor unplugged or damaged.	1. Check if Ti3 plug is connected or not. 2. Check if sensor's resistance is correct or not.
Indoor coil sensor 4 failure (S6 PCB)	Green LED blinks 14 times, stops for 3s	E14	Ti4 sensor unplugged or damaged.	1. Check if Ti4 plug is connected or not. 2. Check if sensor's resistance is correct or not.
PM2.5 sensor failure (S6 PCB)	Green LED blinks 15 times, stops for 3s	E15	PM2.5 sensor unplugged or damaged.	1. Check if PM2.5 plug is connected or not. 2. Check if sensor's resistance is correct or not.
AQI sensor failure (S6 PCB)	Green LED blinks 16 times, stops for 3s	E16	AQI sensor unplugged or damaged.	1. Check if AQI plug is connected or not. 2. Check if sensor's resistance is correct or not.


E. Control Specification: Flexible Function PCB – W Type Control

Abbreviation: Ti1 = Chilled water coil temperature


E.1. I/O Port Definitions

I/O		Code	2-Pipe
Analogue Input	Chilled water Sensor	AI1	Coil sensor (Ti1)
Power input	R1	Lo	230VAC input signals from wired thermostat.
	R2	Med	
	R3	Hi	
	EH	CN4	230VAC input signals from wired thermostat.
Power input	Phase	L	Power supply to the PCB and all the loads connected to the voltage outputs.
	Neutral	N	Power supply to the PCB and all the loads connected to the voltage outputs.
	Earth		Power supply to the PCB and all the loads connected to the voltage outputs.
Digital input	Wired wall pad	TTL	Adjust EC motor RPM
Signal input	0 to +5VDC (0~10VDC)	Signal	0 to +5VDC, SW1=0 (0~10VDC, SW1=1)
Output	EC motor	CN3	EC motor output
	Stepping motor	CN1, CN2	Stepping motor output
	Electric Heater Relay	CN5	When EH signal input is powered on and EC motor RPM>600rpm, EH output is turned on.
	LED Display	X-DIS	LED Display signal

E.2. Wiring diagram

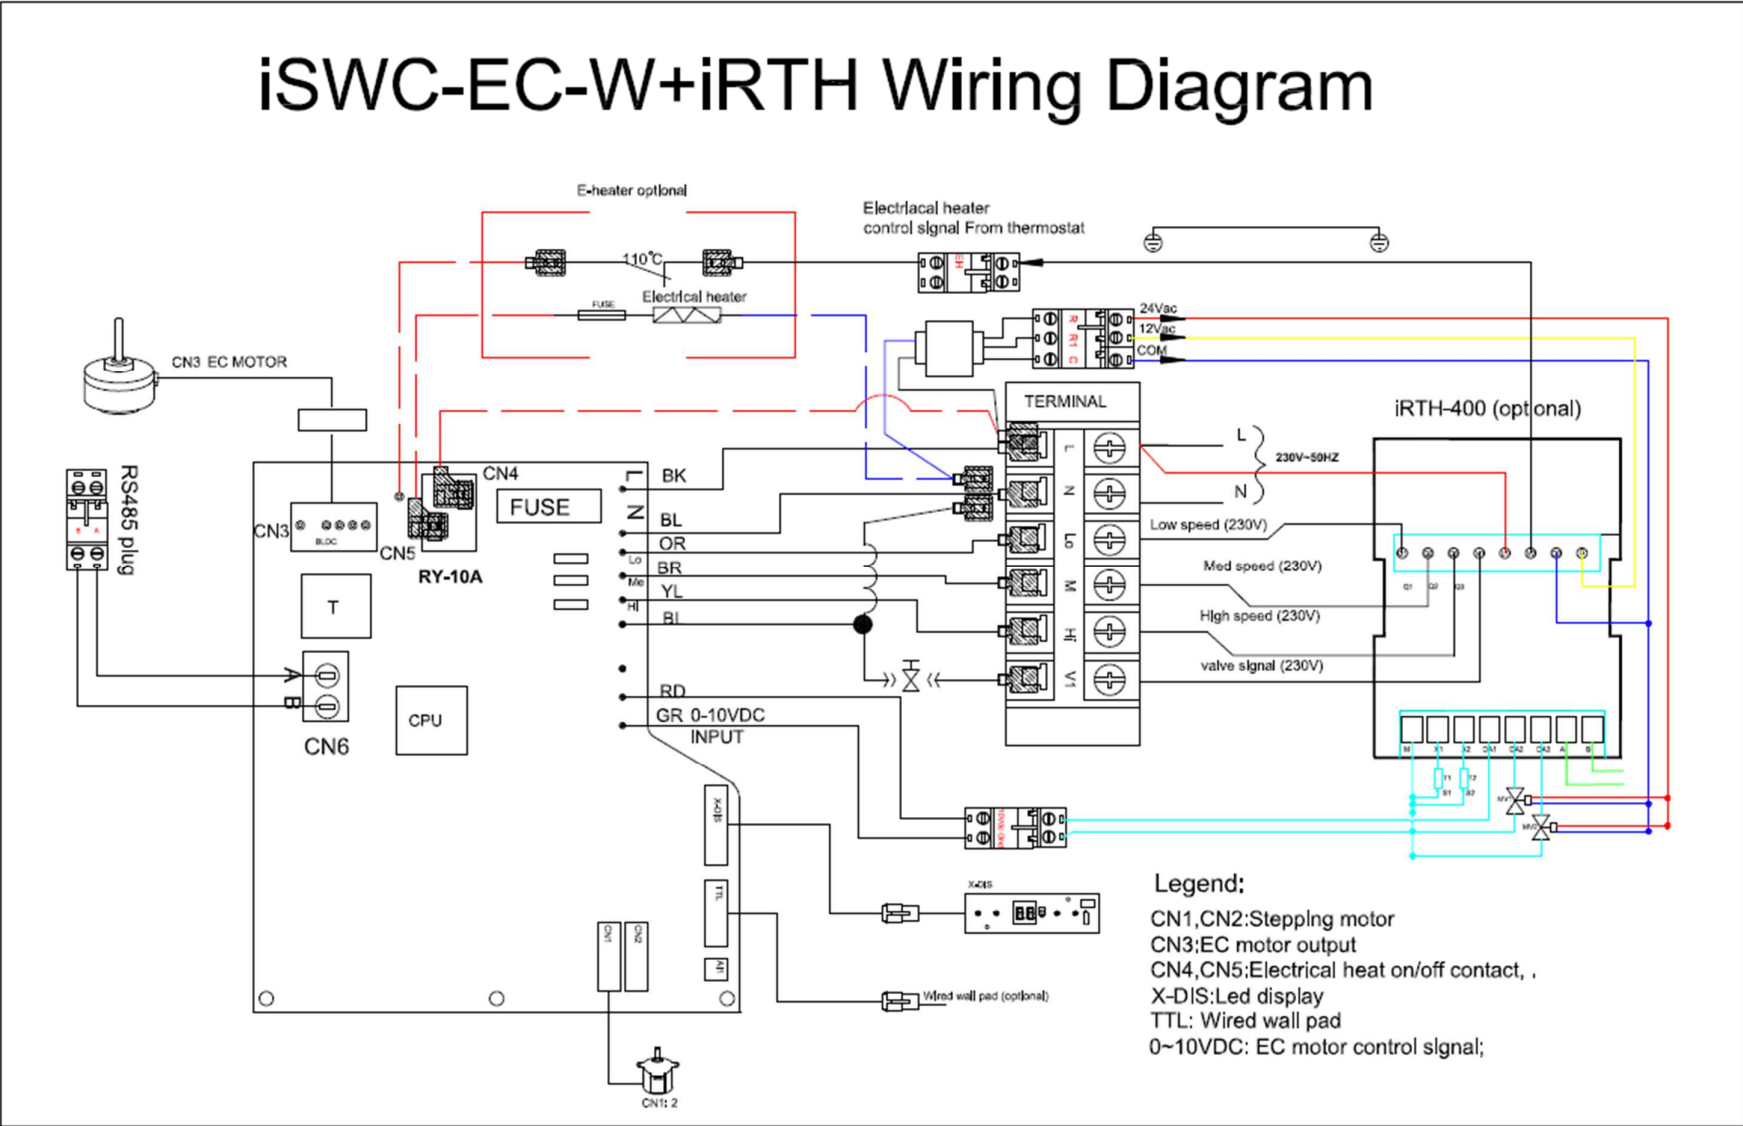

E.3. Onboard configuration



There is 1 DIP switch set on the PCB:

DIPB (8 positions)

- SW1: configured for different modulating signal
- SW2 – SW4: brushless DC fan motor configuration.
- SW5 – SW8: Reserved

Code	State	Description
SW1	0	PCB configured for 0~5VDC modulating signal input.
	1	PCB configured for 0~10VDC modulating signal input.

MODEL	SW2	SW3	SW4	Hi	Med	Low
SWC-04	0	0	0	700	600	500
SWC-06	0	0	1	900	700	600
SWC-12	0	1	0	950	700	600
SWC-15	0	1	1	1100	800	700
SWC-18	1	0	0	1300	1100	900
SWC-20	1	0	1	1100	900	800
SWC-24	1	1	1	1200	1100	900
SWC-30	1	1	0	1350	1200	900
Default RPM	1	1	1	Set by customer requirement		

E.4. Control Logics

1. Power On Setting

When any fan speed is selected, the unit is turned on or modulating signal is more than 2VDC. When all of the fan speed inputs (H/M/L) are off and modulating signal is less than 2VDC, the unit is turned off.

2. Alarm Protection and Error Display

a) If EC motor is failure, EH relay is turned OFF at once.

3. Louver

When the unit is turned on, the louver will open to the largest angle at 100°, then move to the operating angle at 87°. When the unit is turned off, the louver will close.

4. Signal Input

When modulating signal input is more than 2 VDC, the units is turned on. EC motor RPM will be changed by the signal voltage.

5. Electrical Heater Operation

After unit is turned on, EH relay will be ON when EH signal is power on and EC motor RPM>300.

If EC motor failure or EC motor RPM is lower than 300RPM, EH relay is turned OFF at once and report error code.

6. Low Temperature Protection of Indoor Coil in winter

This is frost protection for when the unit is off to prevent water in the coil and room from freezing.

Unit is in Standby Mode

If $Ti1 \leq 2 \text{ }^{\circ}\text{C}$ for 2 minutes, report error code and Buzzer is beeping.



E.5. LED Display and Error Description

For all units Power / Operation LED light (both green)	
Unit on	Power LED Off, Operation LED On
Unit in standby	Power LED On, Operation LED Off

For all units - Operation LED light (Green)				
Item	Blink	LED Display	Reason	Remedy
Indoor coil sensor 1 failure	Green LED blinks 4 times, stops for 3s	E4	Ti1 sensor connection is unplugged or damaged.	1. Check if Ti1 plug is connected or not. 2. Check if sensor's resistance is correct or not.
EC motor failure	Green LED blinks 9 times, stops for 3s	E9	No EC motor feedback	1. Check if EC motor's wires are connected. 2. Check the EC motor
Anti-frozen	Green LED blinks 11 times, stops for 3s	E11	When unit is standby, $Ti1 < 2^{\circ}\text{C}$.	1. Turn on unit to keep $Ti1$ high than 5°C

F. Users Interface

F.1. Remote Control Handset

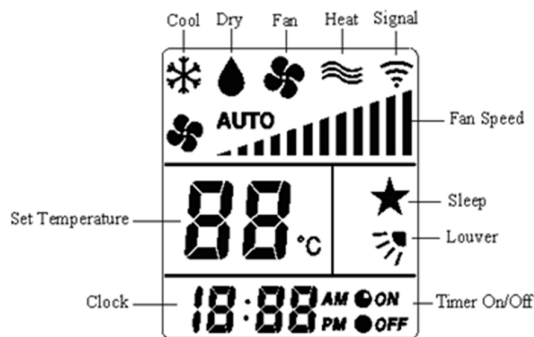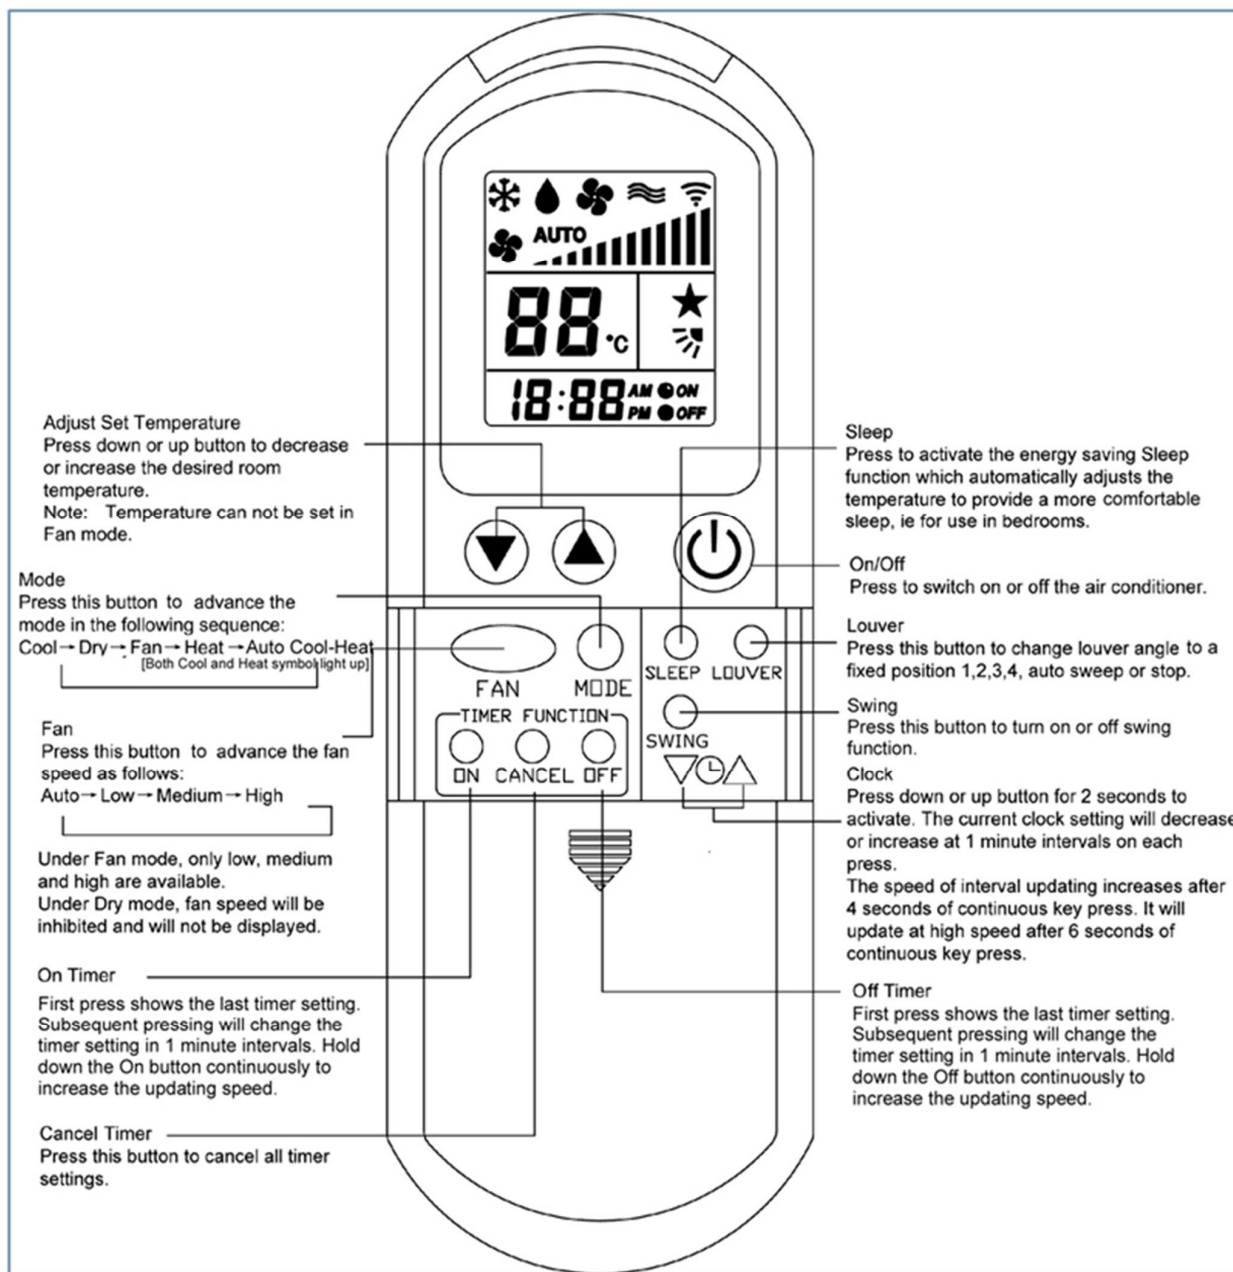

Attention

When unit with handset is the master unit, its settings are automatically sent to the slave units. Auto Cool-Heat operation will be applicable in 4-pipe system only.


“Swing” function is not applicable.

European version only uses degree C setting.

G. Wired Wall Pad Controller Operation Guide





G.1. LED display

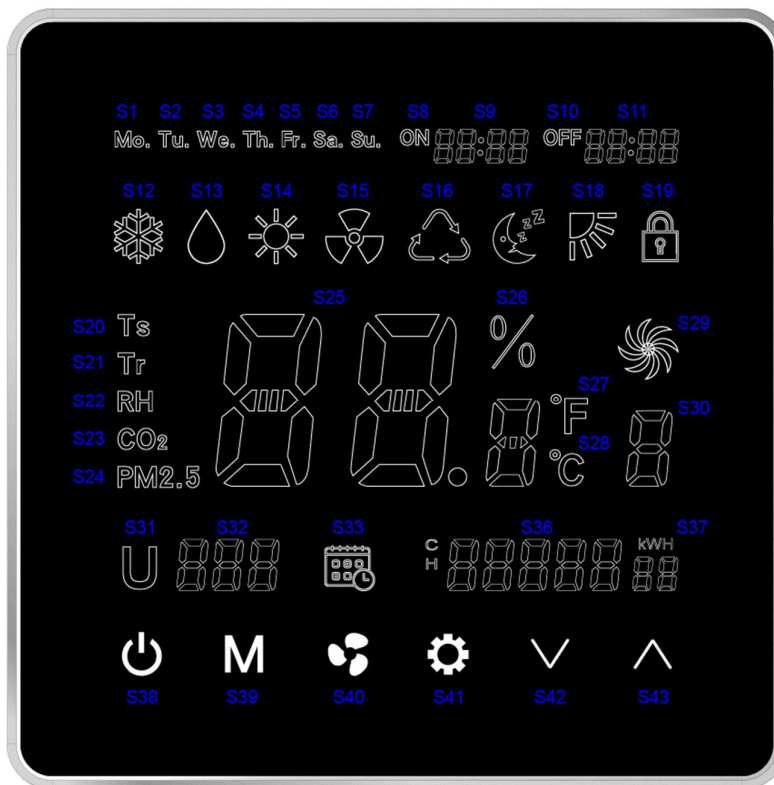






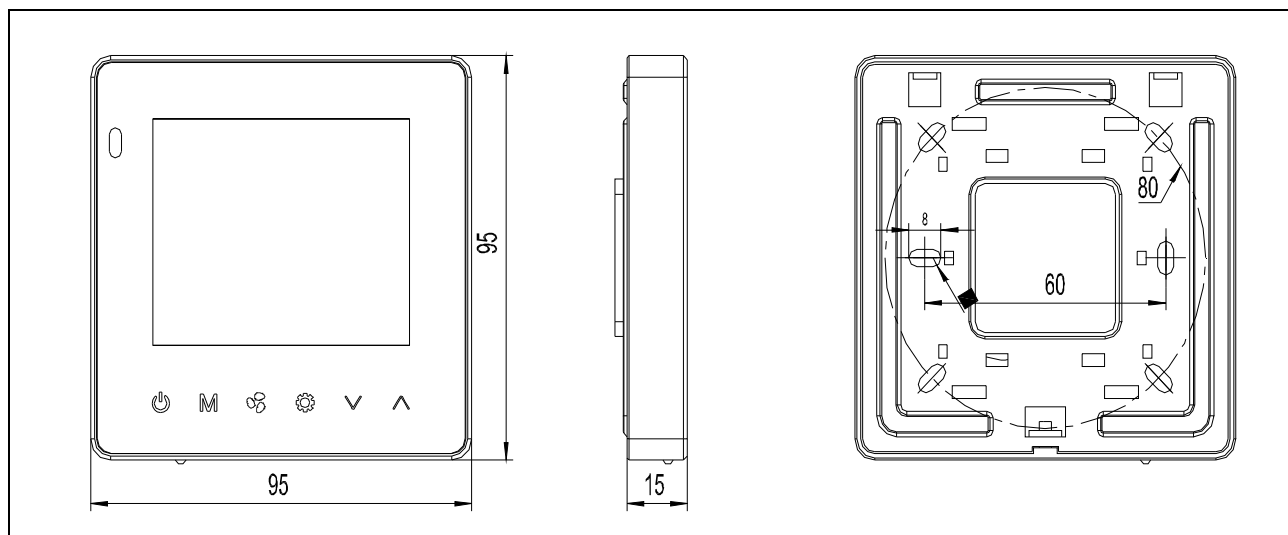

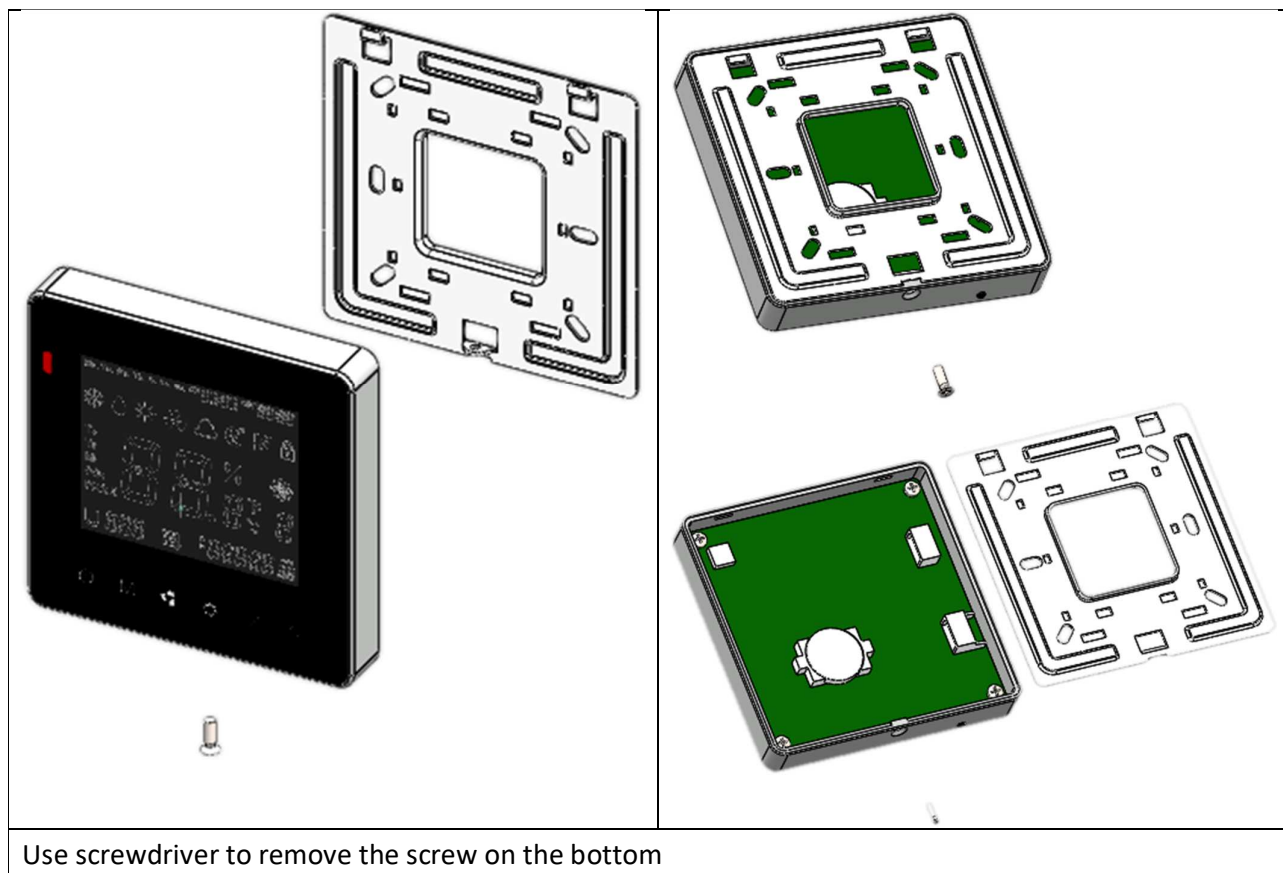

Code	Legend	Code	Legend	Code	Legend
S1	Monday	S16	Auto Mode	S31	Unit address
S2	Tuesday	S17	Sleep mode	S32	Unit No. / Error code
S3	Wednesday	S18	Swing mode	S33	Weekly timer
S4	Thursday	S19	LED lock	S34	C-cooling
S5	Friday	S20	Setting Temperature	S35	H-heating
S6	Saturday	S21	Room Temperature	S36	Energy consumption
S7	Sunday	S22	RH (if need)	S37	Energy consumption cycle
S8	Timer-ON	S23	CO2 density (if need)	S38	On/Off Button
S9	Timer-ON time (When Timer-ON is off: Current time)	S24	PM2.5 density (if need)	S39	Mode setting
S10	Timer-OFF	S25	Data Display	S38	On/Off Button
S11	Timer-OFF time	S26	RH percentage	S39	Mode setting
S12	Cooling Mode	S27	Fahrenheit degree	S40	Fan speed setting
S13	Dehumidification	S28	Celsius degree	S41	Parameter setting
S14	Heating Mode	S29	Fan	S42	Up
S15	Ventilation Mode	S30	0-Auto. 1-Low. 2-Medium. 3-High	S43	Down



















G.2. Dimensions and installation





G.3. Operation guide

S38	On/OFF Button	Press  to turn on. Press it again to turn off.
S39	Mode button	With wall pad on, press  to select Cooling, Dehumidification, Heating, Ventilation or Auto sequentially.
S40	Fan Speed Button	Press  to change from 0 to 3. 0=Auto speed, 1=Low speed, 2=Medium speed, 3=High speed.
S41	Parameter Setting Button	Long press  for 5 seconds to set today's day of week. Press  or  to change from Monday to Sunday.
		Long press  for 5 seconds then short press it once to set current time. Press  or  to change current time.

<p>Long press  for 5 seconds then short press it twice to set Timer ON.</p> <p>Press  to set day of week from Monday to Sunday.</p> <p>Press  or  to change Timer ON time.</p> <p>Press  to turn Timer ON on or off and S8 appears or disappears.</p>
<p>Long press  for 5 seconds then short press it 3 times to set Timer OFF time.</p> <p>Press  to set day of week from Monday to Sunday.</p> <p>Press  or  to change Timer OFF time.</p> <p>Press  to turn Timer OFF on or off and S10 appears or disappears.</p>
<p>Long press  for 5 seconds then short press it 4 times to set group control and U31 appears. The function is reserved.</p>
<p>Long press  for 5 seconds then short press it 5 times to set unit address and U32 appears.</p> <p>Press  or  to change unit address.</p>
<p>Long press  for 5 seconds then short press it 6 times to set unit parameters. Press  to change the parameter type. Press  or  to change parameter setting value.</p> <p>S31/S32 displays “U001”, which is used to set unit type. 0=iAIR Mode: Ventilation T, RH, CO2, PM2.5 are displayed. 1=iFCU Mode: S12, S13, S14, S15, S16, S21 or S20 is displayed. 2=iAHU Mode: S12, S13, S14, S15, S16, S21 or S20 is displayed. 3=iAHU with air cleaner Mode: S12, S13, S14, S15, S16, T, RH, CO2, PM2.5 are displayed.</p> <p>S31/S32 displays “U002”, which is used to set unit of temperature degree. 0=Celsius degree. 1=Fahrenheit degree.</p> <p>S31/S32 displays “U003”, which is used to select display temperature on LCD. 1=Setting temperature. 0=Room temperature.</p> <p>S31/S32 displays “U004”, which is used to set setting temperature range. 0=Setting temperature is from 16~30°C. 1=Cooling setting temperature 24°C, Heating setting temperature 21°C.</p> <p>S31/S32 displays “U005”, which is used to set setting temperature band. 1~9°C.</p> <p>S31/S32 displays “U006-U009”, which are reserved to set parameters with optional accessory to measure PM2.5 and CO2 values.</p> <p>S31/S32 displays “U010~U011”, which are reserved.</p> <p>S31/S32 displays “U012”, which is used to set setting RH point. 30~70, default: 50</p> <p>S31/S32 displays “U013”, which is used to set setting RH band. 10~30, default: 10</p>

*** For
MODBUS
user only

S31/S32 displays “U014”, which is used to set unit address.

1~255, default: 1

S31/S32 displays “U015”, which is used to set unit ESP.

0~100%, default: 40% ,

S31/S32 displays “U016”, which is reserved.

S31/S32 displays “U017”, which is used to set software. (please refer to different PCB)

0=2-pipe with valve

1=2-pipe without valve

2=4-pipe with std valve

3=4-pipe with 6-way

valve

S31/S32 displays “U018”, which is reserved.

S31/S32 displays “U019”, which is used to set DA1 function

When U001=2,3

U019=0, fan control signal is based on Tr, Ts PID calculation

U019=1, fan control signal is based on ESP PID calculation

S31/S32 displays “U020”, which is used to calibrate the sensor on the wired wall pad.

-5~5, default: -3

S31/S32 displays “U021”, which is used to set EH function

U021= 0, without EH.

U021= 1, EH as booster.

U021=2, EH as primary.

S31/S32 displays “U022”, which is used to select Tr sensor.

0=the sensor in the WWP.

1=the sensor in the PCB.

S31/S32 displays “U023”, which is used to display cooling and heating energy consumption.

0=S34/S35/S36/S37 disappears

1=S34/S35/S36/S37 appears

In cooling and dehumidification mode, cooling energy consumption is shown.

In heating mode, heating energy consumption is shown.

2=Motor running time is shown.

S31/S32 displays “U024”, which is used to set low speed RPM or control signal.

S31/S32 displays “U025”, which is used to set medium speed RPM or control signal.

S31/S32 displays “U026”, which is used to set high speed RPM or control signal.







S31/S32 displays “U027”, which is used to set Delta T OF Ti1/Ti2.

S31/S32 displays “U028”, which is used to set Delta T OF Ti3/Ti4.

S31/S32 displays “U029”, which is used to read unit type.

S31/S32 displays “U030”, which is used to read unit model.

S31/S32 displays “U031”, which is used to read unit manufacturing date.

S32	Error code	<p>S32 : E** blinks</p> <p>Bit0 = Room temperature sensor error Bit1 = Ti1 temperature sensor error Bit2 = Ti2 temperature sensor error Bit3 = Float switch error</p> <p>Bit4 = Indoor coil low temperature protection Bit5 = Indoor coil overheat protection</p> <p>Bit6 =Filter switch</p> <p>Bit7 = Electrical heater failure Bit8 = Motor1 Error</p> <p>Bit9 =Motor2 Error</p> <p>Bit10 = System parameters error Bit11 = Anti-frozen error</p> <p>Bit12 = Ti3 temperature sensor error Bit13 = Ti4 temperature sensor error Bit14 =PM2.5 sensor error Bit15 =AQI Error</p>
Combination Button Function		<p>Screen Lock Function</p> <p>Long press  for 5 seconds, S19 appears and screen is locked.</p> <p>Long press  for 5 seconds again, S19 disappears and screen is unlocked.</p>
		<p>Swings Function</p> <p>Long press  for 5 seconds, S18 appears and swings is ON.</p> <p>Long press  for 5 seconds again, S18 disappears and swings is OFF.</p>
		<p>Sleep Mode</p> <p>Long press  for 5 seconds, S17 appears and sleep mode is ON.</p> <p>Long press  for 5 seconds again, S17 disappears and sleep mode is OFF.</p>

G.4. Error codes

Error Description	Code	Reason	Remedy
Room temperature sensor error	E1	Room sensor unplugged or damaged.	1. Check if Tr plug is connected or not.
			2. Check if sensor's resistance is correct or not.
Indoor coil sensor 1 failure	E2	Ti1 sensor unplugged or damaged.	1. Check if Ti1 plug is connected or not.
			2. Check if sensor's resistance is correct or not.
Indoor coil sensor 2 failure	E3	Ti2 sensor unplugged or damaged.	1. Check if Ti2 plug is connected or not.
			2. Check if sensor's resistance is correct or not.
Float switch error	E4	Float switch is opened.	1. Check if the condensate water pipe is connected or not.
			2. Check if the pump is functioning or not.
Indoor coil low temperature protection	E5	Water temperature is lower than 3 °C.	Check the water temperature.
Indoor coil overheat protection	E6	Water temperature is higher than 70 °C.	Check the water temperature
Filter switch protection	E7	Filter Switch is open.	Replace or clean filter.
Electric Heater failure	E8	Only for unit with EH.	1. Change fan speed to high.
		EH safety switch is opened.	2. Replace the damaged EH safety switch.
EC motor failure (CN4)	E9	No EC motor feedback	1. Check Modbus setting.
			2. Check the EC motor.
EC motor failure (CN5)	E10	No EC motor feedback	1. Check Modbus setting.
			2. Check the EC motor.
Motor qty setting error (S6 PCB)	E11	Motor Qty setting error	1: check Modbus setting
Anti-frozen protection	E12	When unit is standby, Tr<2°C.	1. Turn on unit to keep Tr high than 5°C
Indoor coil sensor 3 failure (S6 PCB)	E13	Ti3 sensor unplugged or damaged.	1. Check if Ti3 plug is connected or not.
			2. Check if sensor's resistance is correct or not.
Indoor coil sensor 4 failure (S6 PCB)	E14	Ti4 sensor unplugged or damaged.	1. Check if Ti4 plug is connected or not.
			2. Check if sensor's resistance is correct or not.
PM2.5 sensor failure (S6 PCB)	E15	PM2.5 sensor unplugged or damaged.	1. Check if PM2.5 plug is connected or not.
			2. Check if sensor's resistance is correct or not.
AQI sensor failure (S6 PCB)	E16	AQI sensor unplugged or damaged.	1. Check if AQI plug is connected or not.
			2. Check if sensor's resistance is correct or not.
Wired Wall Pad failure	E17	WWP unplugged or not well	1. Check plugs

H. Sensor Resistance R-T Conversion Table

Resistance: $R(25^{\circ}\text{C}) = 10\text{k}\Omega \pm 1\%$ Beta Constant: $B(25/85) = 3977 \pm 1\%$

Temp. (deg. C)	Rmax (k Ohms)	Rnor (k Ohms)	Rmin (k Ohms)	Temp. (deg. C)	Rmax (k Ohms)	Rnor (k Ohms)	Rmin (k Ohms)
-30	186.3613	179.2666	172.4247	5	25.9521	25.4562	24.9672
-29	174.9608	168.4053	162.0793	6	24.6872	24.2274	23.7738
-28	164.3317	158.2726	152.4218	7	23.4912	23.0650	22.6443
-27	154.4170	148.8151	143.4022	8	22.3599	21.9650	21.5750
-26	145.1643	139.9837	134.9746	9	21.2897	20.9239	20.5622
-25	136.5254	131.7332	127.0964	10	20.2768	19.9380	19.6028
-24	128.4558	124.0216	119.7285	11	19.3178	19.0041	18.6937
-23	120.9146	116.8107	112.8348	12	18.4096	18.1193	17.8318
-22	113.8640	110.0648	106.3818	13	17.5493	17.2807	17.0146
-21	107.2691	103.7512	100.3387	14	16.7340	16.4857	16.2394
-20	101.0977	97.8396	94.6771	15	15.9612	15.7317	15.5040
-19	95.3201	92.3020	89.3705	16	15.2284	15.0164	14.8059
-18	89.9088	87.1124	84.3946	17	14.5333	14.3376	14.1432
-17	84.8385	82.2471	79.7268	18	13.8738	13.6933	13.5139
-16	80.0856	77.6837	75.3463	19	13.2479	13.0816	12.9160
-15	75.6284	73.4018	71.2336	20	12.6537	12.5005	12.3479
-14	71.4468	69.3823	67.3708	21	12.0895	11.9485	11.8080
-13	67.5220	65.6077	63.7412	22	11.5535	11.4239	11.2946
-12	63.8370	62.0616	60.3295	23	11.0442	10.9252	10.8064
-11	60.3755	58.7288	57.1212	24	10.5602	10.4510	10.3419
-10	57.1228	55.5953	54.1032	25	10.1000	10.0000	9.9000
-9	54.0651	52.6480	51.2629	26	9.6709	9.5709	9.4710
-8	51.1895	49.8747	48.5889	27	9.2623	9.1626	9.0630
-7	48.4842	47.2643	46.0705	28	8.8732	8.7738	8.6747
-6	45.9381	44.8062	43.6978	29	8.5025	8.4037	8.3052
-5	43.5409	42.4906	41.4615	30	8.1494	8.0512	7.9534
-4	41.2831	40.3086	39.3531	31	7.8128	7.7154	7.6184
-3	39.1559	38.2516	37.3644	32	7.4919	7.3953	7.2993
-2	37.1508	36.3117	35.4880	33	7.1859	7.0903	6.9953
-1	35.2603	34.4817	33.7169	34	6.8940	6.7995	6.7056
0	33.4771	32.7547	32.0447	35	6.6156	6.5221	6.4294
1	31.7945	31.1243	30.4652	36	6.3498	6.2576	6.1660
2	30.2064	29.5847	28.9728	37	6.0962	6.0051	5.9148
3	28.7068	28.1301	27.5623	38	5.8540	5.7642	5.6752
4	27.2904	26.7556	26.2286	39	5.6227	5.5342	5.4465

Temp. (deg. C)	Rmax (k Ohms)	Rnor (k Ohms)	Rmin (k Ohms)	Temp. (deg. C)	Rmax (k Ohms)	Rnor (k Ohms)	Rmin (k Ohms)
40	5.4018	5.3146	5.2283	77	1.4137	1.3722	1.3317
41	5.1907	5.1049	5.0199	78	1.3681	1.3275	1.2880
42	4.9890	4.9045	4.8210	79	1.3243	1.2845	1.2458
43	4.7961	4.7130	4.6309	80	1.2820	1.2431	1.2053
44	4.6117	4.5300	4.4494	81	1.2413	1.2033	1.1663
45	4.4354	4.3551	4.2759	82	1.2021	1.1649	1.1287
46	4.2667	4.1878	4.1100	83	1.1644	1.1279	1.0926
47	4.1053	4.0278	3.9515	84	1.1279	1.0923	1.0577
48	3.9508	3.8748	3.7999	85	1.0928	1.0580	1.0241
49	3.8030	3.7283	3.6548	86	1.0590	1.0249	0.9918
50	3.6614	3.5882	3.5161	87	1.0264	0.9930	0.9606
51	3.5258	3.4540	3.3833	88	0.9949	0.9623	0.9306
52	3.3960	3.3255	3.2562	89	0.9646	0.9326	0.9016
53	3.2715	3.2025	3.1346	90	0.9353	0.9040	0.8737
54	3.1523	3.0846	3.0181	91	0.9070	0.8764	0.8468
55	3.0380	2.9717	2.9065	92	0.8797	0.8498	0.8208
56	2.9285	2.8635	2.7996	93	0.8534	0.8241	0.7958
57	2.8234	2.7597	2.6972	94	0.8280	0.7994	0.7716
58	2.7227	2.6603	2.5990	95	0.8035	0.7754	0.7483
59	2.6260	2.5649	2.5049	96	0.7798	0.7523	0.7258
60	2.5333	2.4734	2.4147	97	0.7569	0.7300	0.7041
61	2.4443	2.3856	2.3282	98	0.7348	0.7085	0.6831
62	2.3589	2.3014	2.2452	99	0.7134	0.6877	0.6628
63	2.2768	2.2206	2.1656	100	0.6928	0.6676	0.6433
64	2.1981	2.1431	2.0892	101	0.6728	0.6482	0.6244
65	2.1224	2.0686	2.0159	102	0.6536	0.6295	0.6062
66	2.0498	1.9970	1.9455	103	0.6349	0.6113	0.5885
67	1.9800	1.9283	1.8779	104	0.6169	0.5938	0.5715
68	1.9129	1.8623	1.8130	105	0.5995	0.5769	0.5550
69	1.8484	1.7989	1.7507	106	0.5826	0.5605	0.5391
70	1.7864	1.7380	1.6908	107	0.5663	0.5447	0.5237
71	1.7267	1.6794	1.6332	108	0.5506	0.5293	0.5089
72	1.6694	1.6231	1.5779	109	0.5353	0.5145	0.4945
73	1.6142	1.5689	1.5247	110	0.5206	0.5002	0.4806
74	1.5612	1.5168	1.4736	111	0.5063	0.4863	0.4671
75	1.5101	1.4667	1.4245	112	0.4924	0.4729	0.4541
76	1.4610	1.4185	1.3772	113	0.4791	0.4599	0.4415

I. Troubleshooting

Symptoms	Cause	Remedy
The fan coil does not start up	No voltage	Check for presence of voltage Check fuse on board
	Mains switch in the "OFF position	Place in the "ON" position
	Faulty room control	Check the room control
	Faulty fan	Check fan motor
Insufficient output	Filter clogged	Clean the filter
	Air flow obstructed	Remove obstacles
	Room control regulation	Check the room air sensor
	Incorrect water temperature	Check the water source
	Air present	Check the air vent
Noise and vibrations	Contact between metal parts	Check for loosening parts
	Loose screws	Tighten screws



Note: All the information or data in this manual may be changed without notice.

EUROPE

C / Rio Jucar, Nave 6 P.I El Saladar
Lorquí; Murcia, Spain 30564
Ph: (+34) 968 046 262

ASIA

6 On Ping St, R.6 - Block A, 9th Floor,
New Trade Plaza, Shatin, Hong Kong
Ph: (+852) 2648 8887

www.pghvac.com

contact@pghvac.com